

Digos Water District

Water Statistics (July 2015)



OPERATING HIGHLIGHTS

Water Produced




Water produced this month is 0.433 million m³, slightly down by 0.92% from last month's 0.437 million m³. This is however, higher at 8.08% from the same month last year at 0.398 million m³.

Billed Consumption

Billed consumption this month is the same from last month's statistics at 0.340 million m³. It is nonetheless higher by 9.70% from the same month last year at 0.307 million m³.

Non-Revenue Water (NRW)


NRW this month at 21.46% is lower by 0.69 percentage points from last month's 22.15%. This month's NRW is likewise low by 1.30 percentage points compared to the NRW of the same month a year ago with 22.76%.

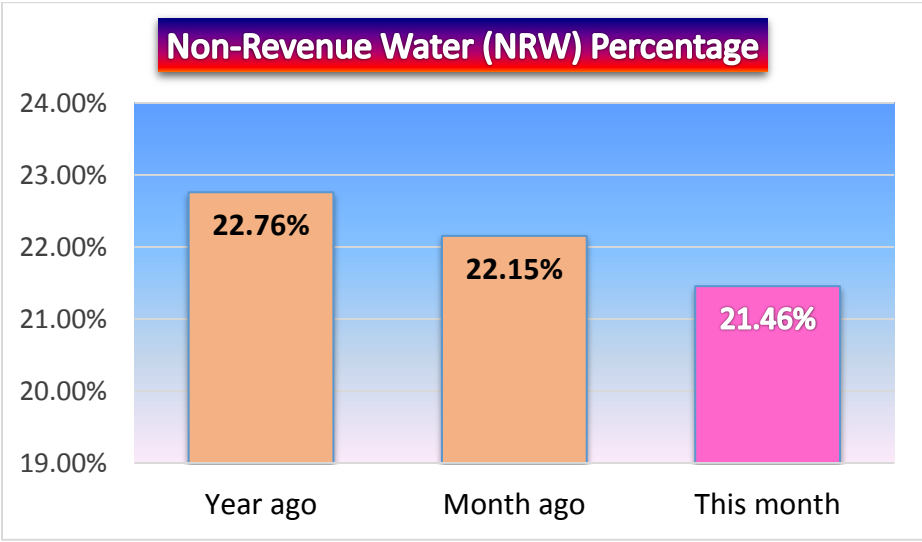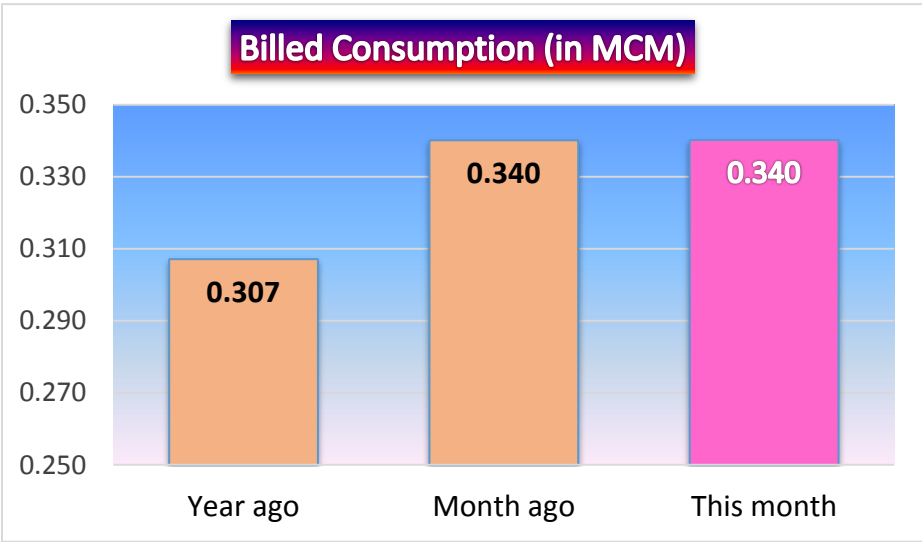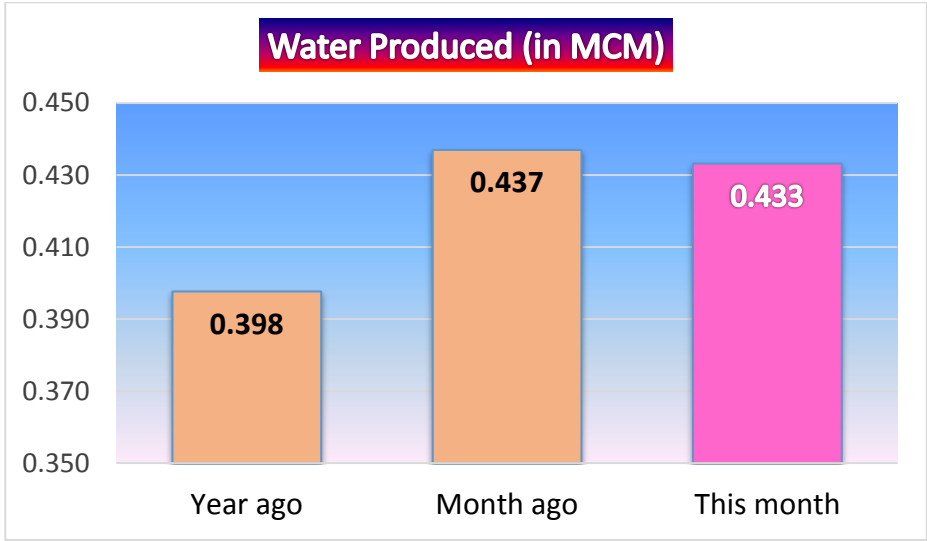


Digos Water District

Water Statistics (July 2015)


New Connection and Active Connection

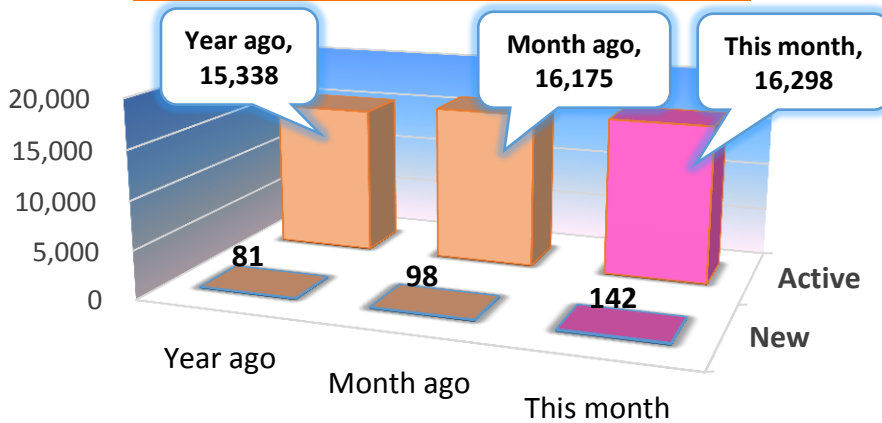

Kilometers of Main Lines in Use

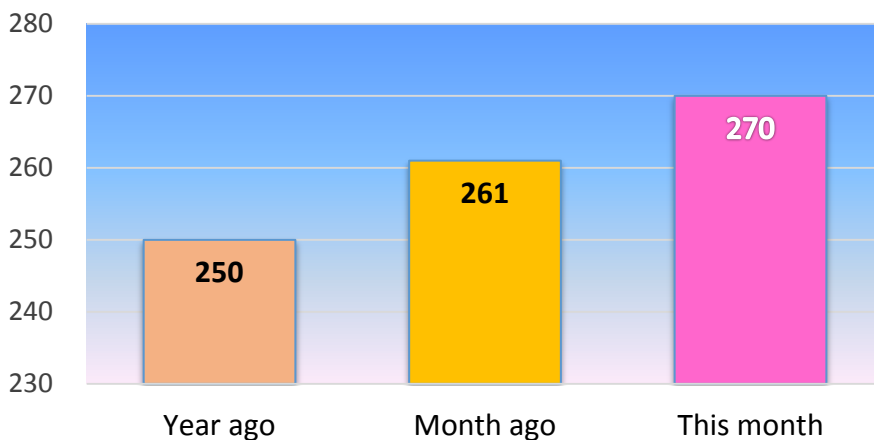

Power Consumption (in million kWh)

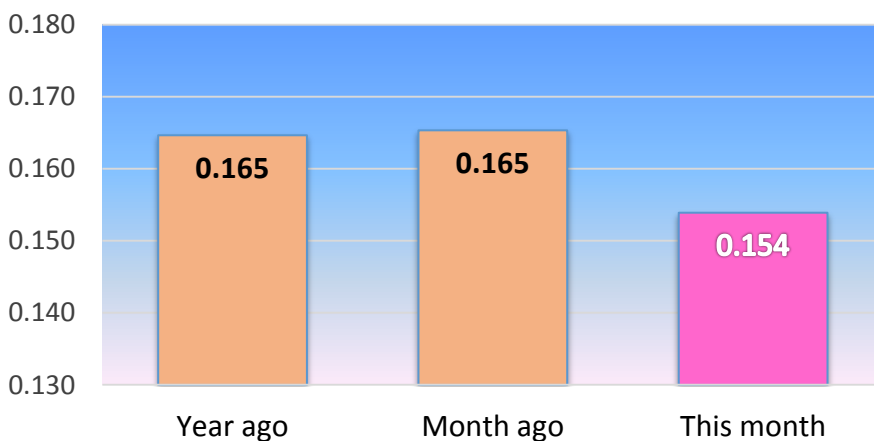

OTHER KEY HIGHLIGHTS

No. of Service Connections

142 new service connections were installed this month up by 30.99% from last month's 98. This figure is even higher at 42.96% from the same month last year with 81.

Active connection this month with 16,298 is 0.75% higher than last month's 16,175 and 5.89% higher than the same month last year with 15,338.

Main lines in Use

9 kms. of pipelines were added this month at 270 kms. from last month's 261 kms. This increase is cumulative since January 2015 and it was at this point that this is recorded. This is 20 kms. more than the same month last year with 250 kms. main lines in use.

Power Consumption

Power consumption of all DWD facilities this month reached 0.154 million kWh, lower by 6.67% from last month's 0.165 million kWh. Last month's stat is the same as that from last year's data and thus, it is 6.67% lower compared to this month.

**Data Source: Approved Financial Statement – July 2015*

Digos Water District Water Statistics (July 2015)

Water Quality Microbiological Test

Population actually served by utility	81,485
Required minimum number of sample	17
No. of samples examined 17	
• Samples showing presence of coliform group	0
• Samples showing presence of coliform colonies	n/a
• Samples showing presence of fecal coliform	0
• Heterotrophic Plate Count (HPC)	
○ % of samples that meets standard	100%
Average Chlorine Residual	0.4 ppm

Employee Profile

