



Digos Water District

Water Statistics (August 2015)


Water Produced (in MCM)

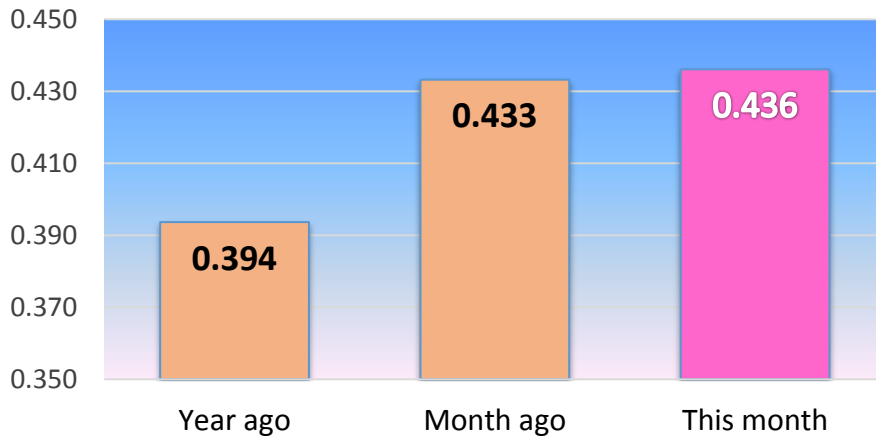

Billed Consumption (in MCM)

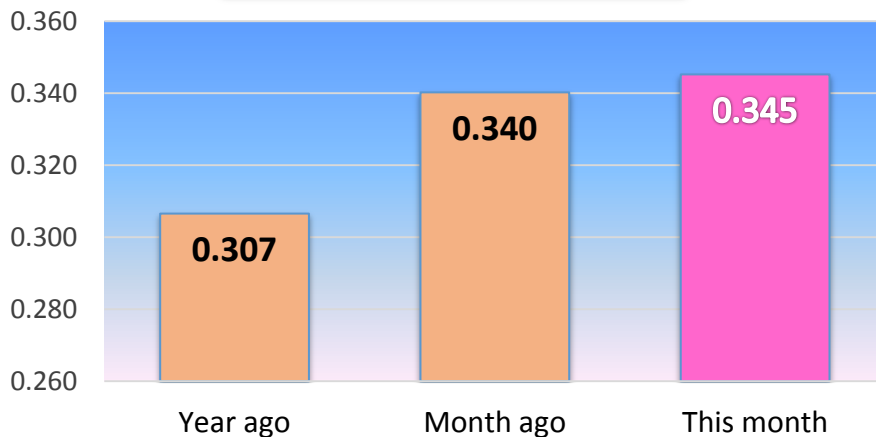

Non-Revenue Water (NRW) Percentage

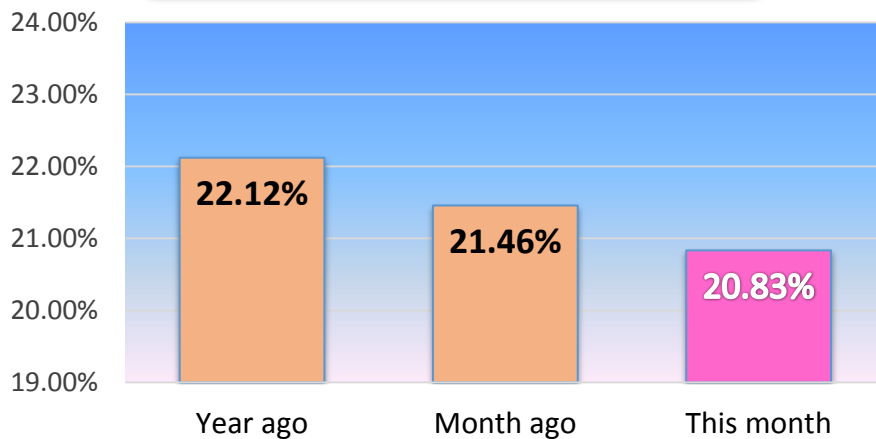

OPERATING HIGHLIGHTS

Water Produced

Water produced this month is 0.436 million m³, slightly up by 0.69% from last month's 0.433 million m³. This is also higher at 9.63% from the same month last year at 0.394 million m³.

Billed Consumption

Billed consumption this month with 0.345 million m³ is up by 1.45% from last month's statistics at 0.340 million m³. It is also higher by 11.01% from the same month last year at 0.307 million m³.


Non-Revenue Water (NRW)

NRW this month at 20.83% is lower by 0.63 percentage points from last month's 21.46%. This month's NRW is likewise lower by 1.29 percentage points compared to the NRW of the same month a year ago with 22.12%.

Digos Water District

Water Statistics (August 2015)


OTHER KEY HIGHLIGHTS

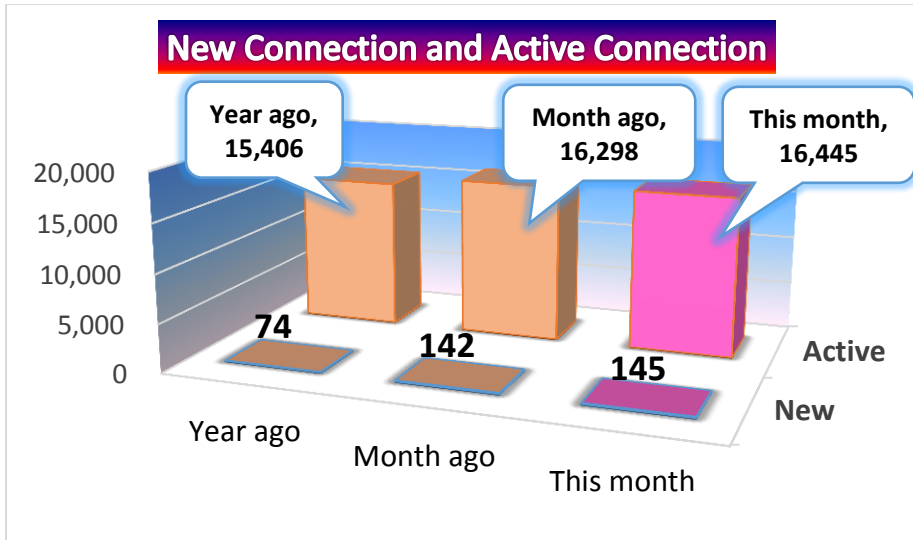

No. of Service Connections


145 new service connections were installed this month, up by 2.07% from last month's 142. This figure is higher at 48.97% from the same month last year with 74.

Active connection this month with 16,445 is 0.89% higher than last month's 16,298 and 6.32% higher than the same month last year with 15,406.

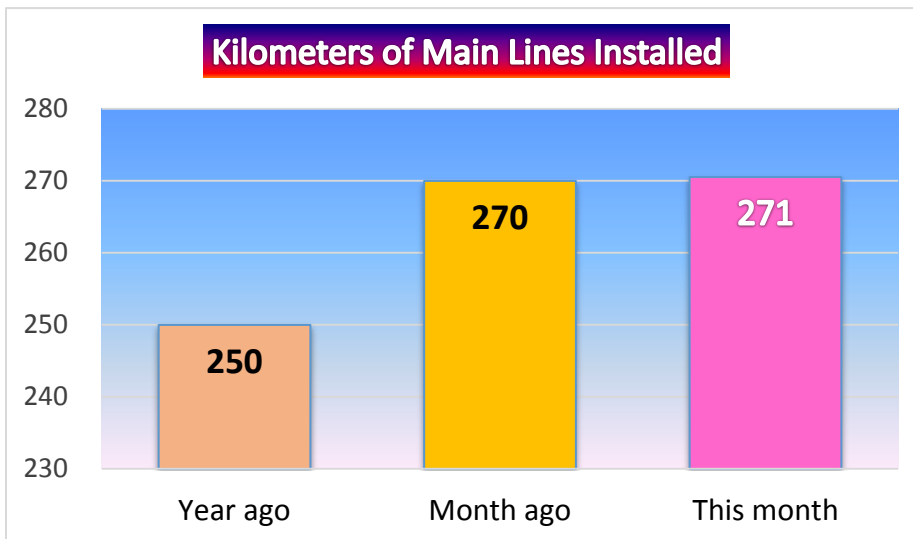

Main lines installed

1 km. of pipelines were added this month at 271 kms. from last month's 270 kms. This is 21 kms. more than the same month last year with 250 kms. main lines installed.

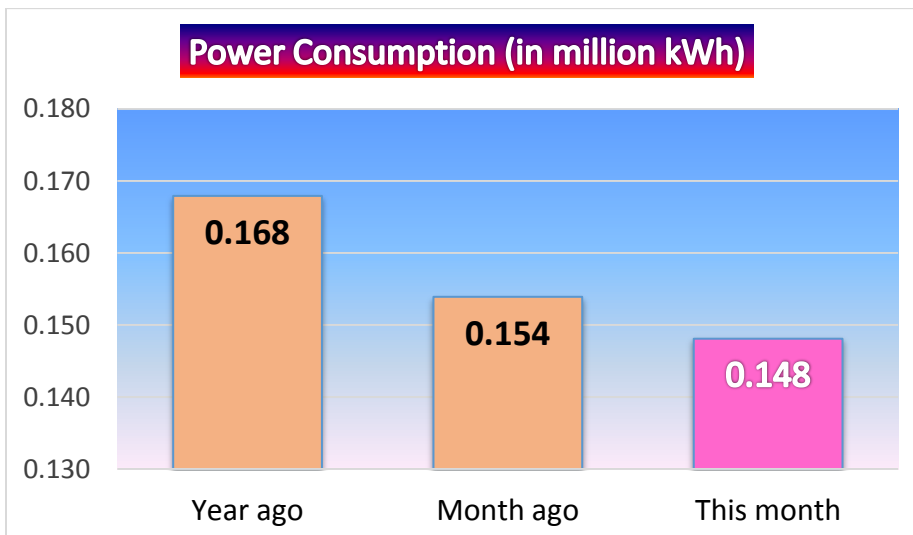

Power Consumption

Power consumption of all DWD facilities this month reached 0.148 million kWh, lower by 4.05% from last month's 0.154 million kWh. Last month's stat is lower by 13.51% from last year's data with 0.168 million kWh.

**Data Source: Approved Financial Statement –August 2015*

Digos Water District

Water Statistics (August 2015)

Water Quality

Microbiological Test

Population actually served by utility	82,230
Required minimum number of sample	17
No. of samples examined	
<ul style="list-style-type: none"> • Samples showing presence of coliform group • Samples showing presence of coliform colonies • Samples showing presence of fecal coliform • Heterotrophic Plate Count (HPC) <ul style="list-style-type: none"> ○ % of samples that meets standard 	17 0 n/a 0 100%
Average Chlorine Residual	0.4 ppm

Employee Profile

