
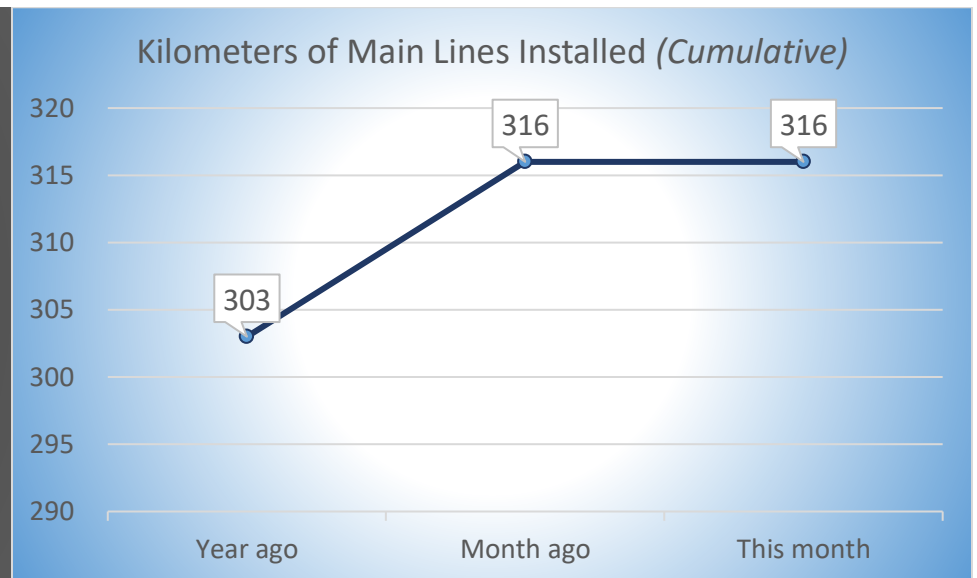
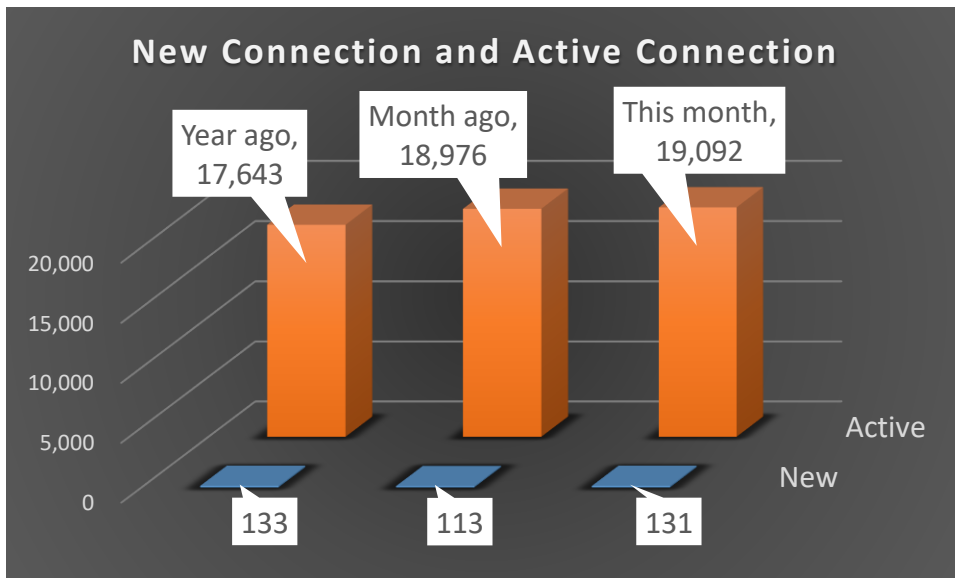
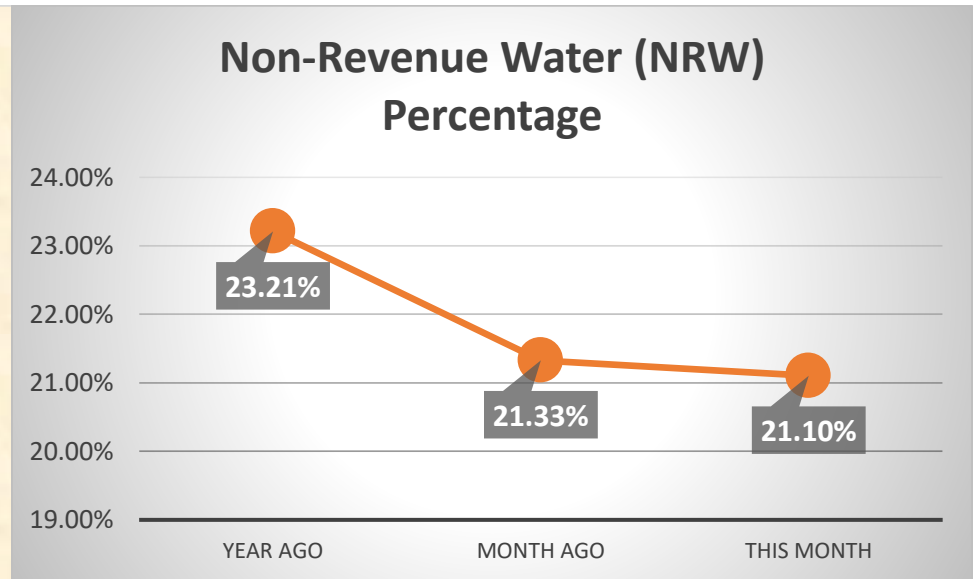



Digos Water District

Water Statistics (August 2017)

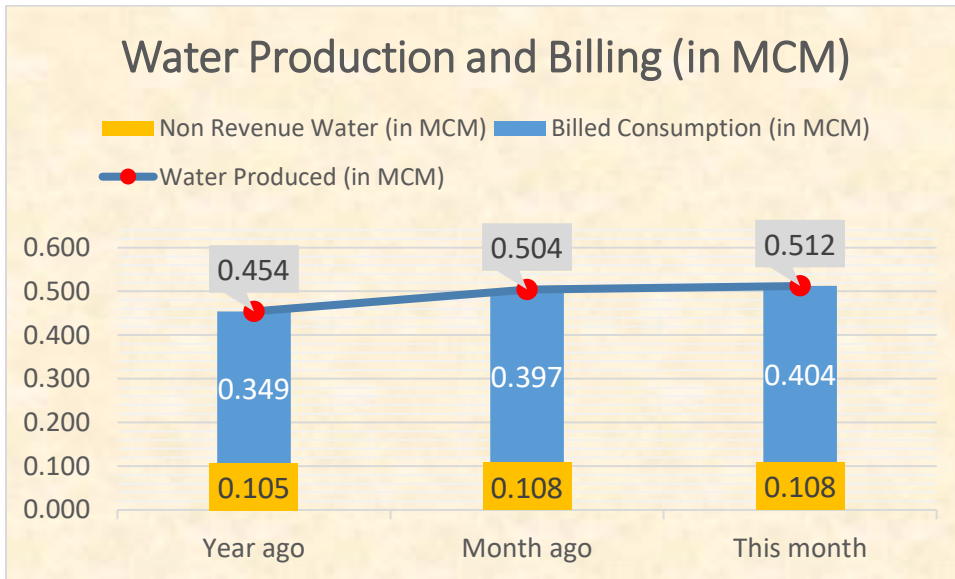

Digos Water District

Water Statistics (August 2017)

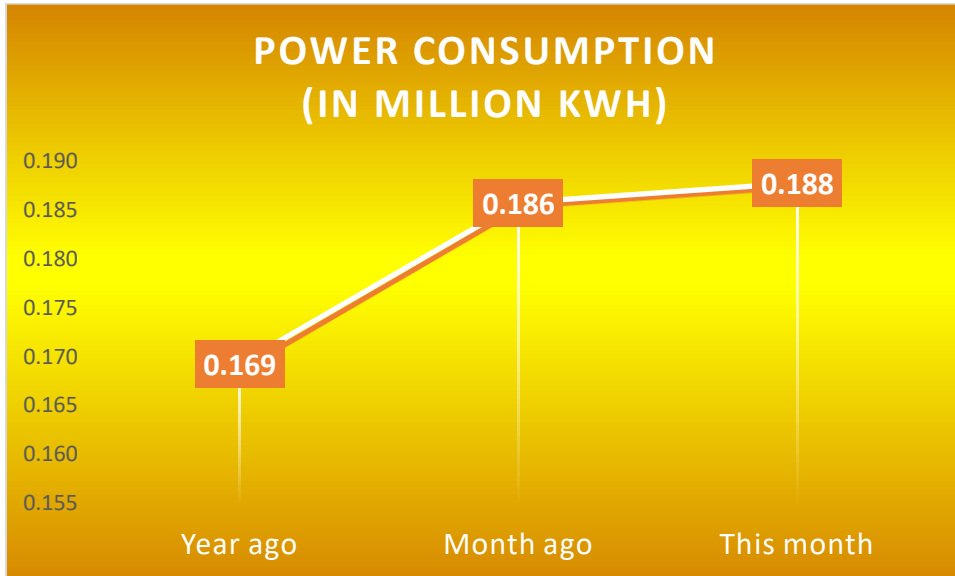

Water Quality

Microbiological Test

Population actually served by utility	95,460
Required minimum number of sample	19
No. of samples examined	20
<ul style="list-style-type: none"> Samples showing presence of coliform group Samples showing presence of coliform colonies Samples showing presence of fecal coliform Heterotrophic Plate Count (HPC) <ul style="list-style-type: none"> % of samples that meets standard 	0 n/a 0 100%
Average Chlorine Residual	0.46 ppm

