
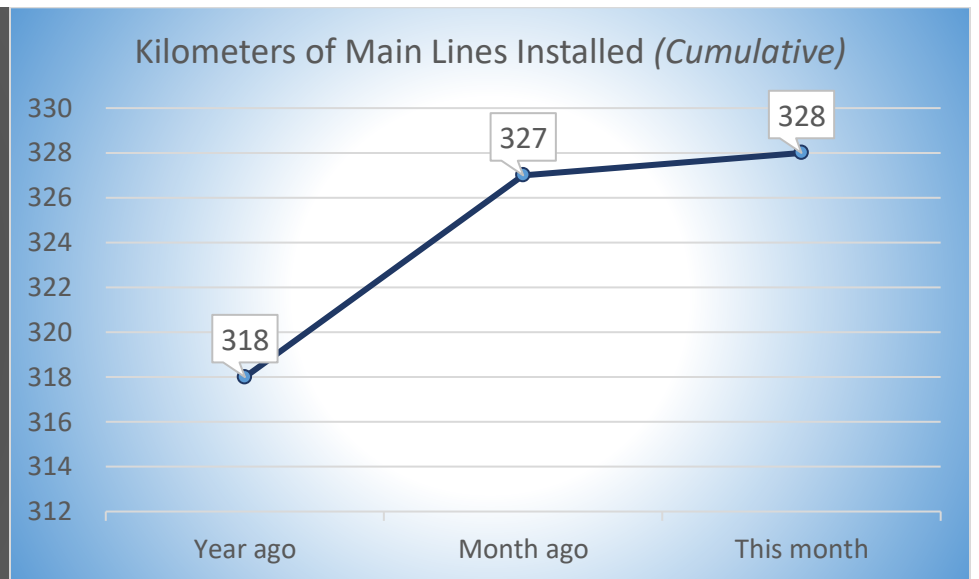
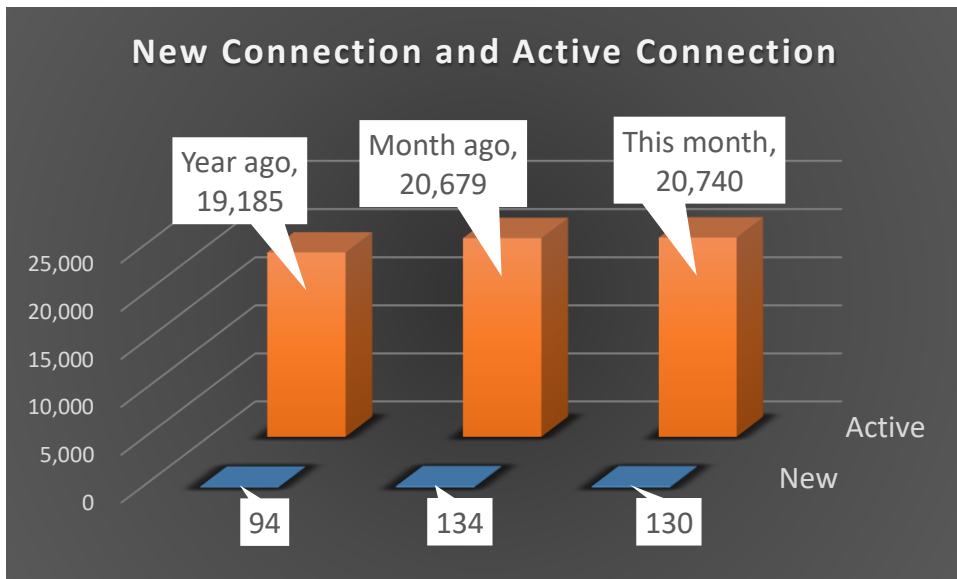
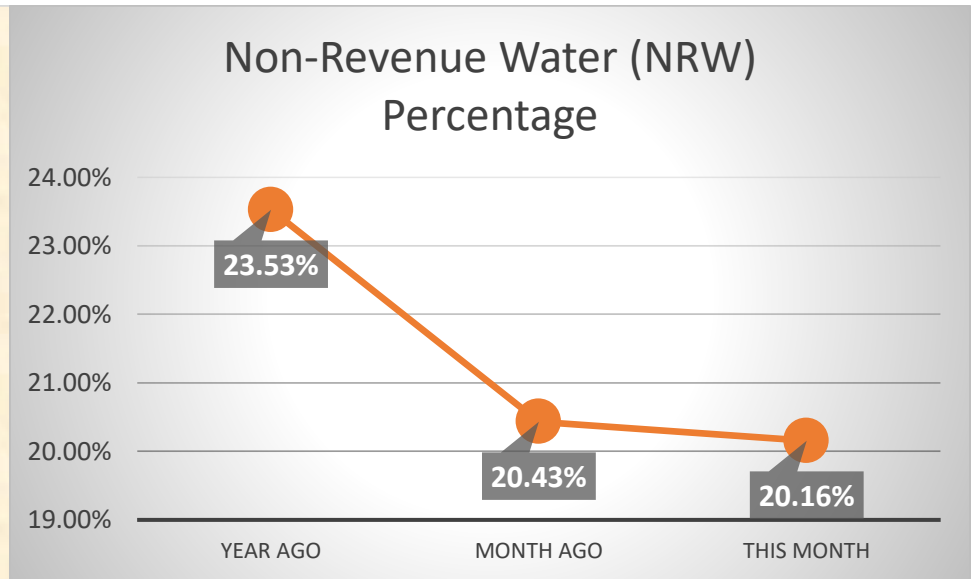



# Digos Water District

## Water Statistics (September 2018)

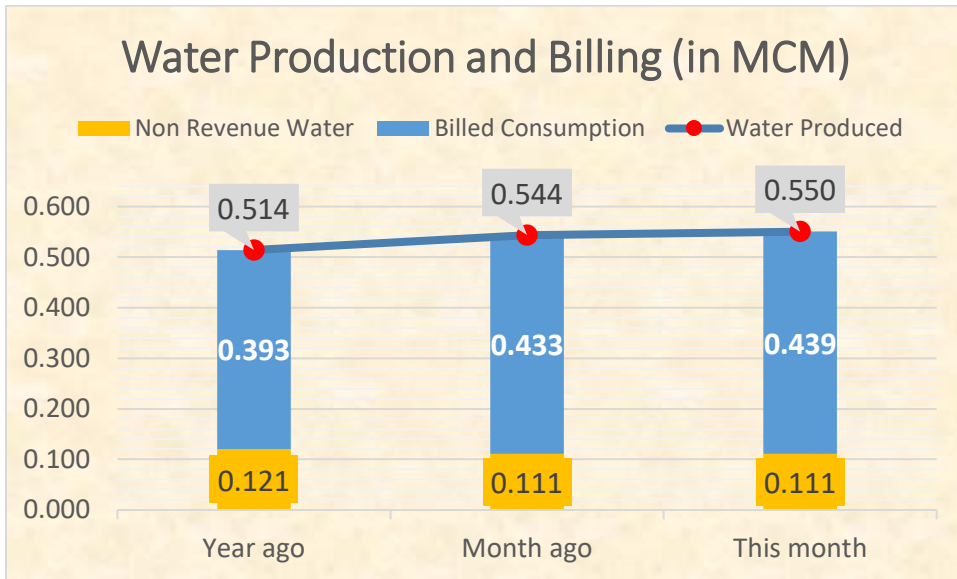

# Digos Water District


## Water Statistics (September 2018)

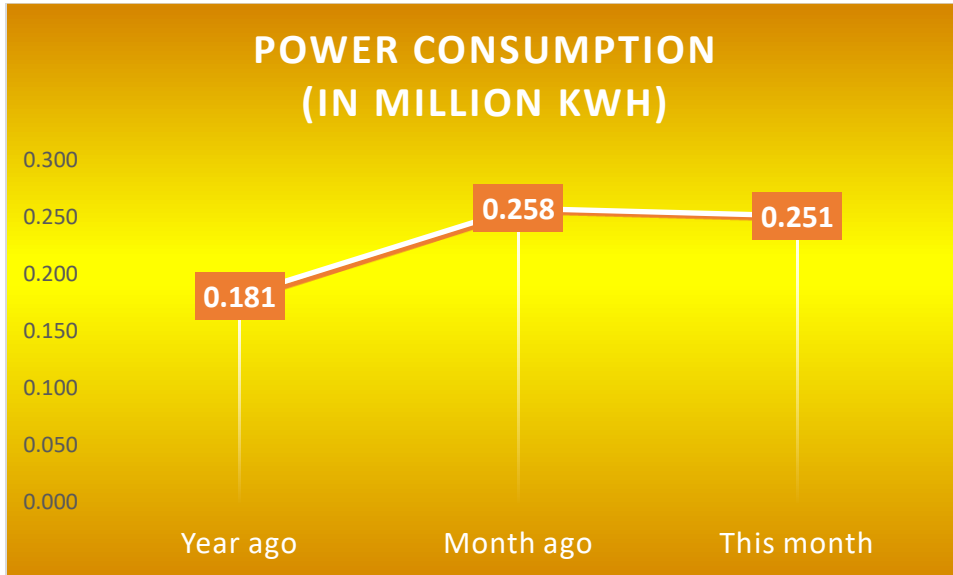

### Water Quality

#### Microbiological Test

|   |          |
|---|----------|
| Population actually served by utility           | 103,700  |
| Required minimum number of sample               | 24       |
| <hr/>   |          |
| No. of samples examined                         | 24       |
| • Samples showing presence of coliform group    | 0        |
| • Samples showing presence of coliform colonies | n/a      |
| • Samples showing presence of coliform          | n/a      |
| • Heterotrophic Plate Count (HPC)               |          |
| ○ % of samples that meets standard              | 100%     |
| <hr/>   |          |
| Average Chlorine Residual                       | 0.48 ppm |

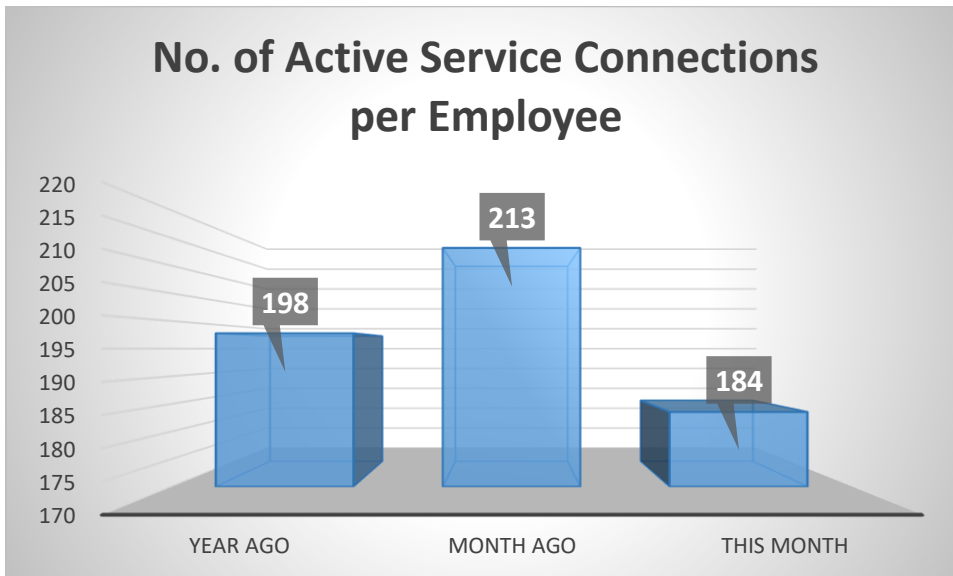

### EMPLOYEE PROFILE

