
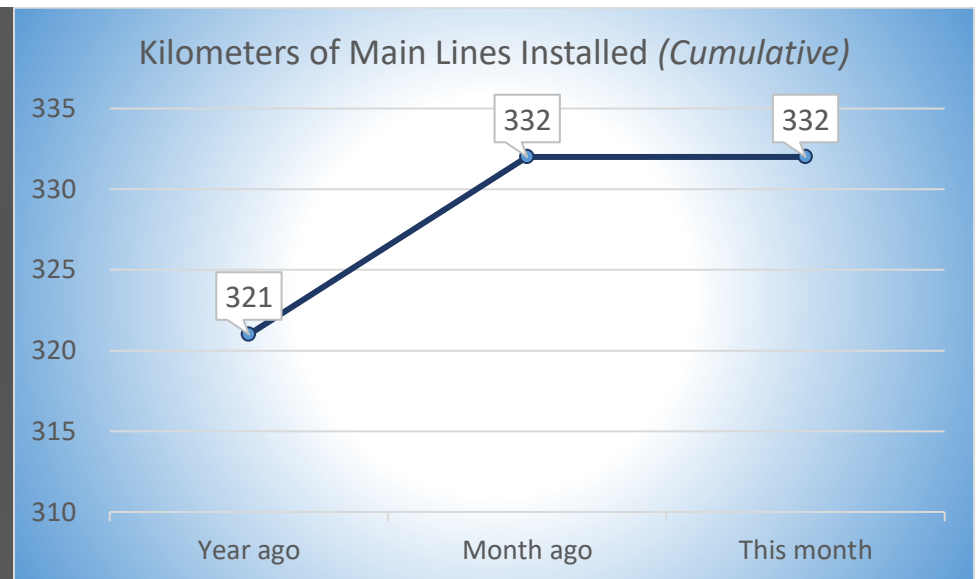
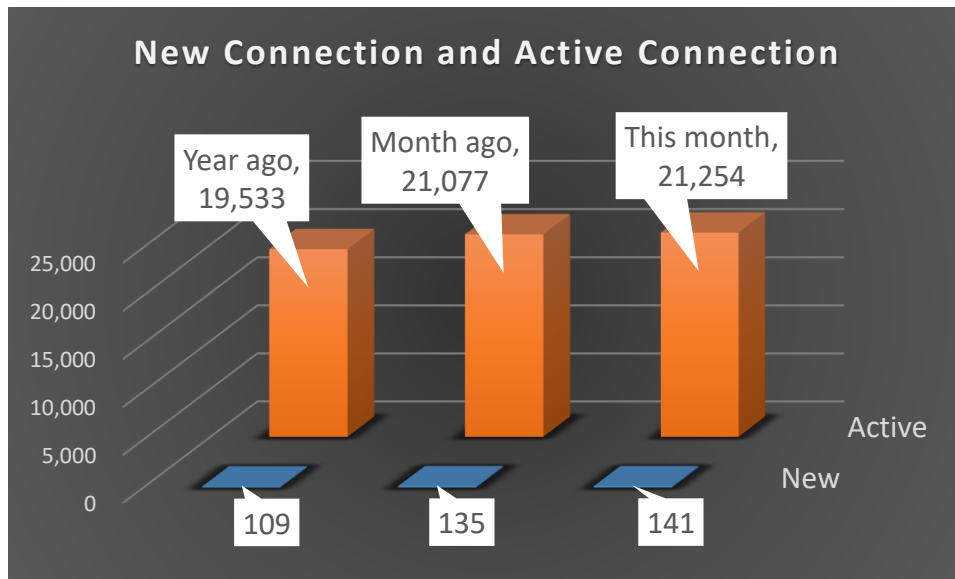
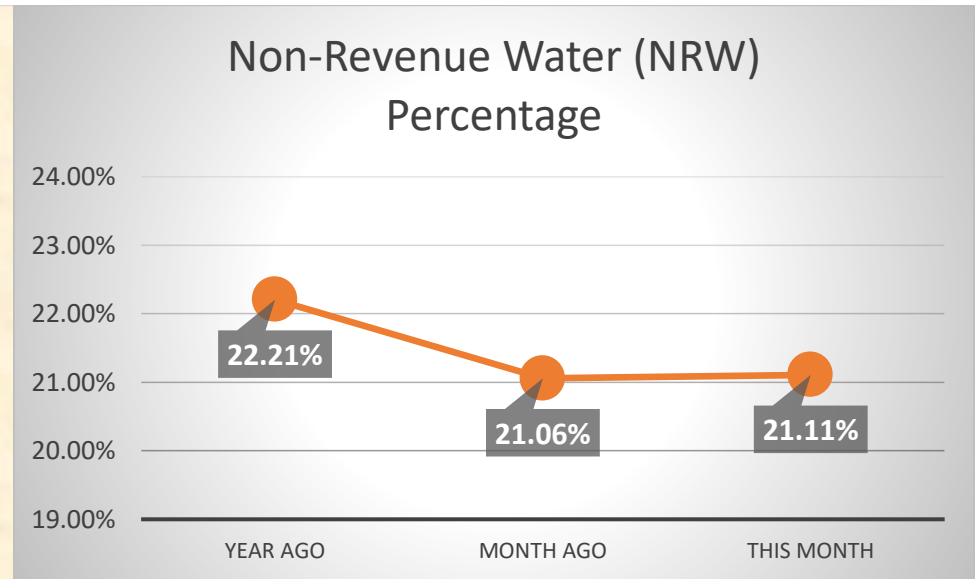



Digos Water District

Water Statistics (December 2018)

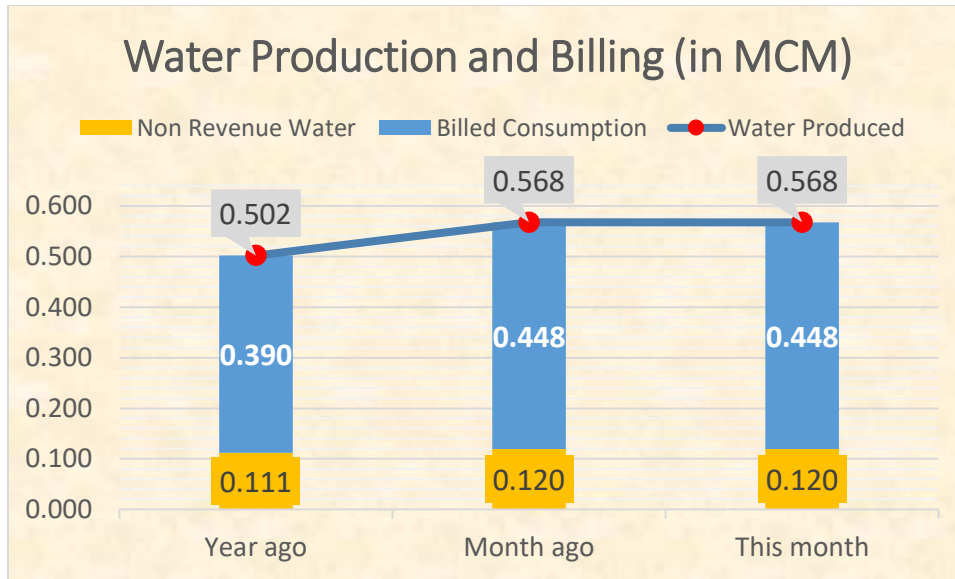

Digos Water District


Water Statistics (December 2018)

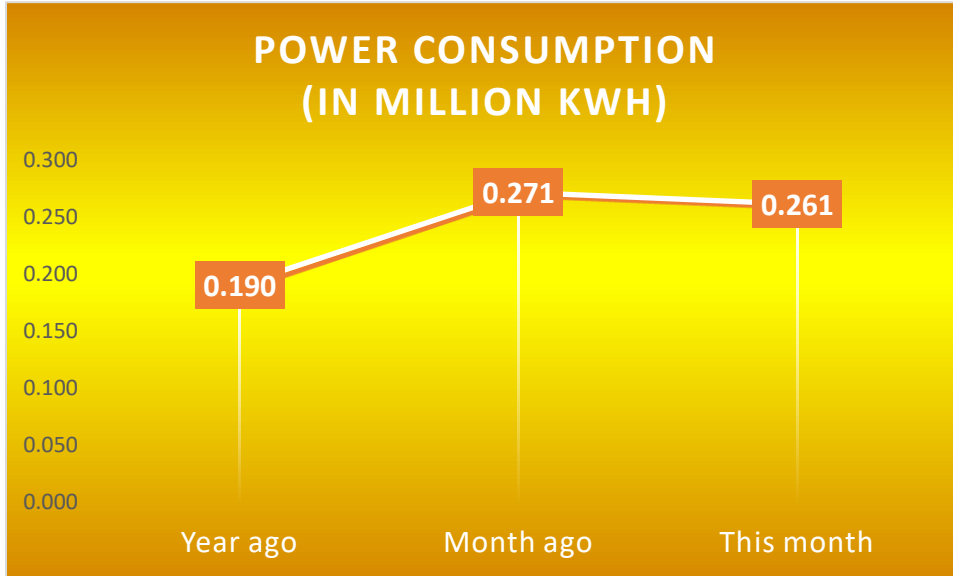

Water Quality

Microbiological Test

| | |
|---|----------|
| Population actually served by utility | 106,270 |
| Required minimum number of sample | 24 |
| <hr/> | |
| No. of samples examined | 25 |
| • Samples showing presence of coliform group | 0 |
| • Samples showing presence of coliform colonies | n/a |
| • Samples showing presence of coliform | n/a |
| • Heterotrophic Plate Count (HPC) | |
| ○ % of samples that meets standard | 100% |
| <hr/> | |
| Average Chlorine Residual | 0.48 ppm |

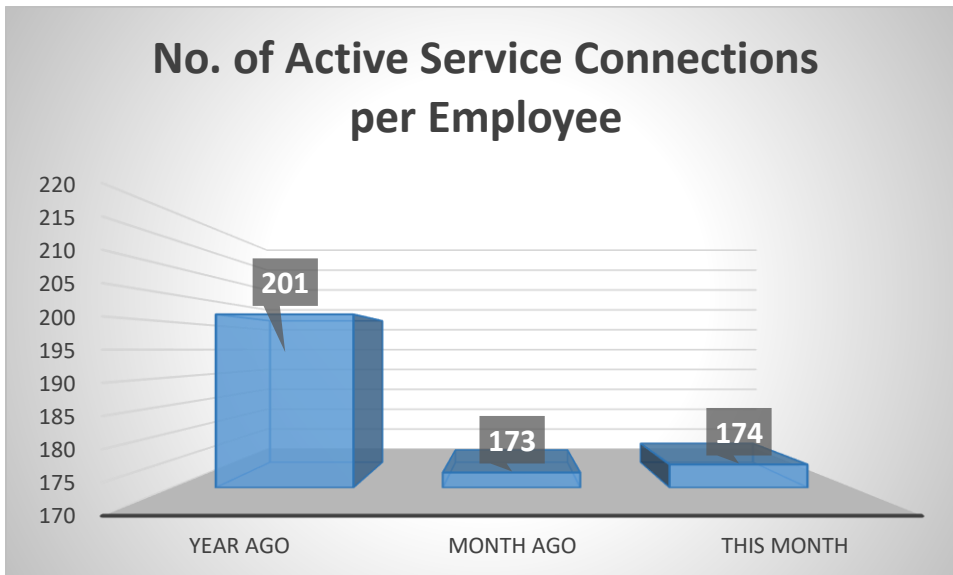

EMPLOYEE PROFILE

