
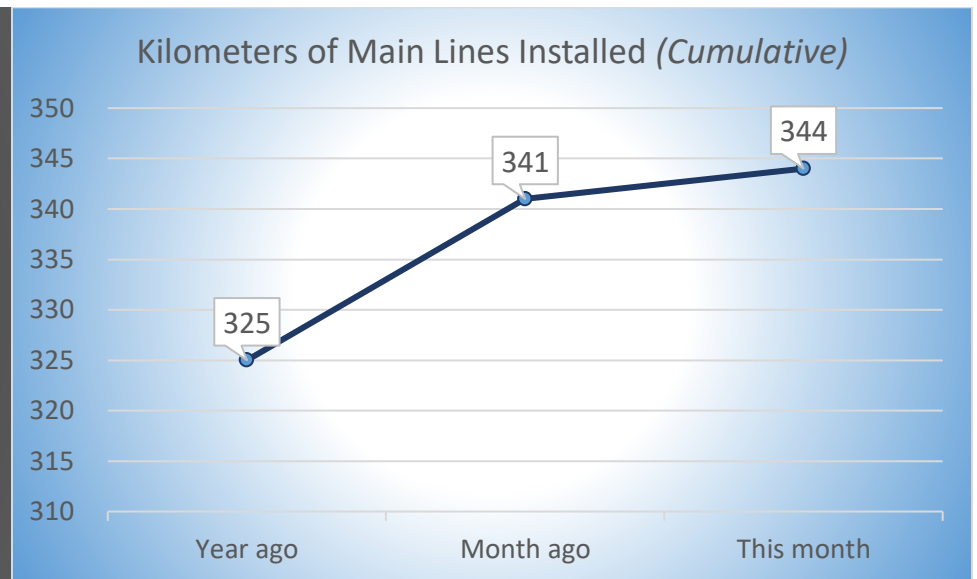
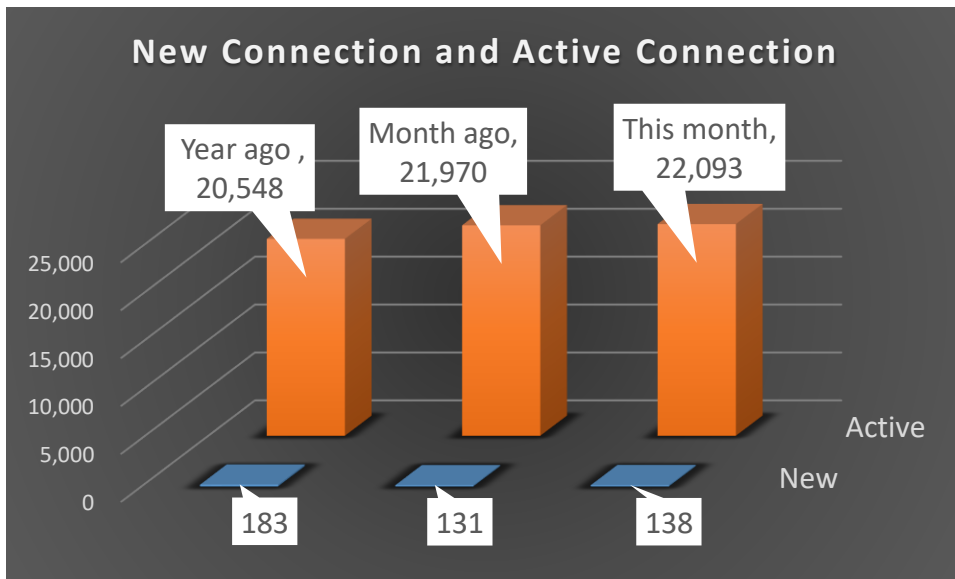
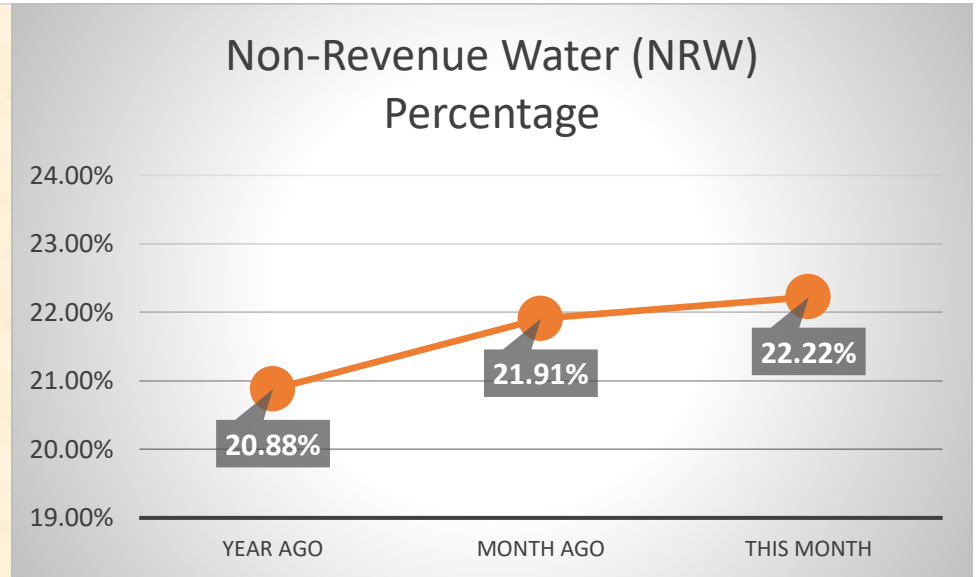



Digos Water District

Water Statistics (July 2019)

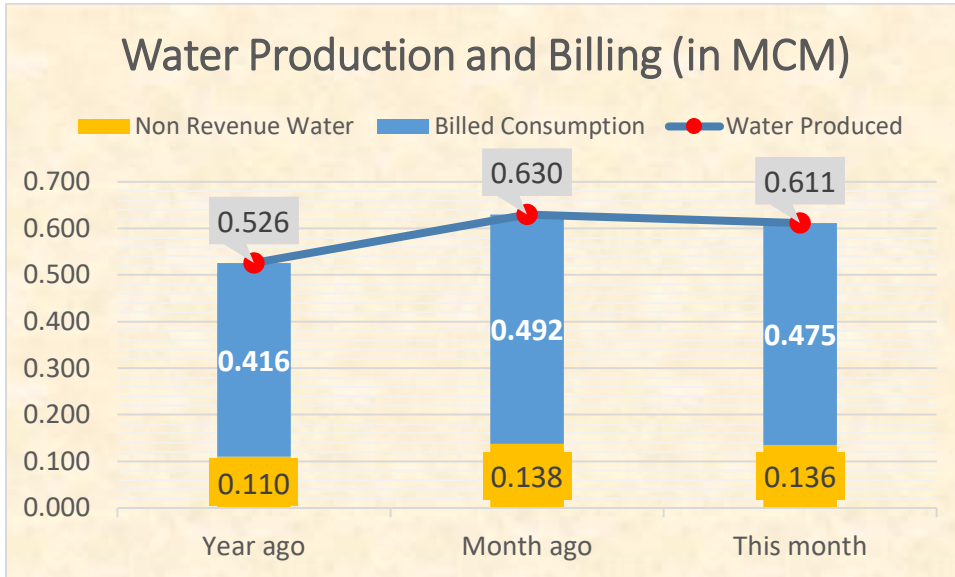

Digos Water District

Water Statistics (July 2019)

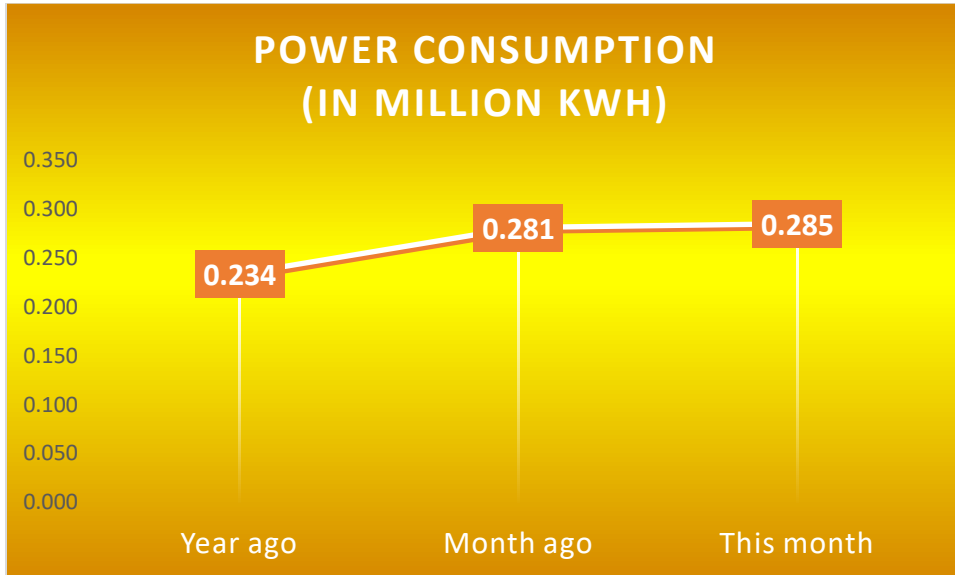

Water Quality

Microbiological Test

Population actually served by utility	110,465
Required minimum number of sample	24
<hr/>	
No. of samples examined	27
<ul style="list-style-type: none"> Samples showing presence of coliform group Samples showing presence of coliform colonies Samples showing presence of coliform Heterotrophic Plate Count (HPC) <ul style="list-style-type: none"> % of samples that meets standard 	0 n/a n/a 100%
Average Chlorine Residual	0.46 ppm

