
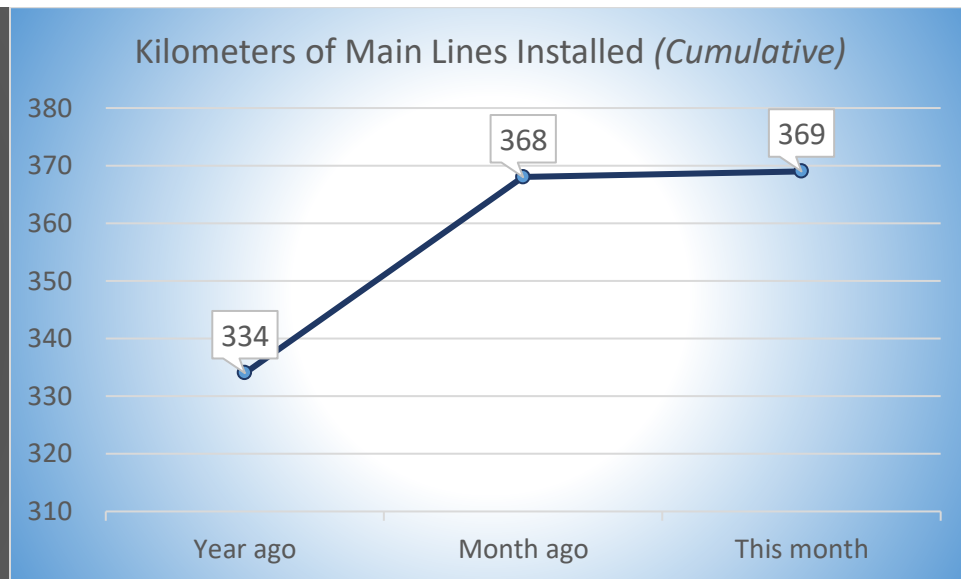
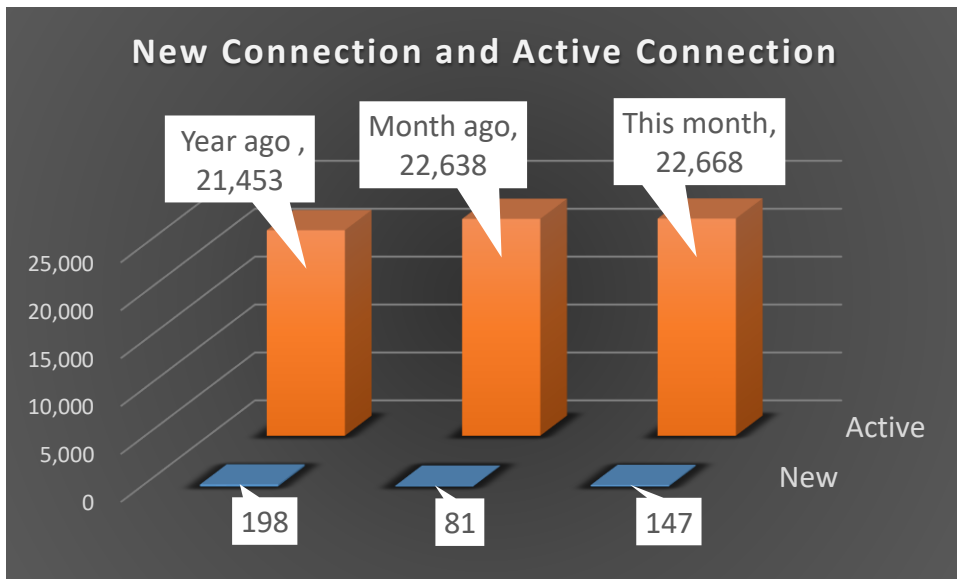
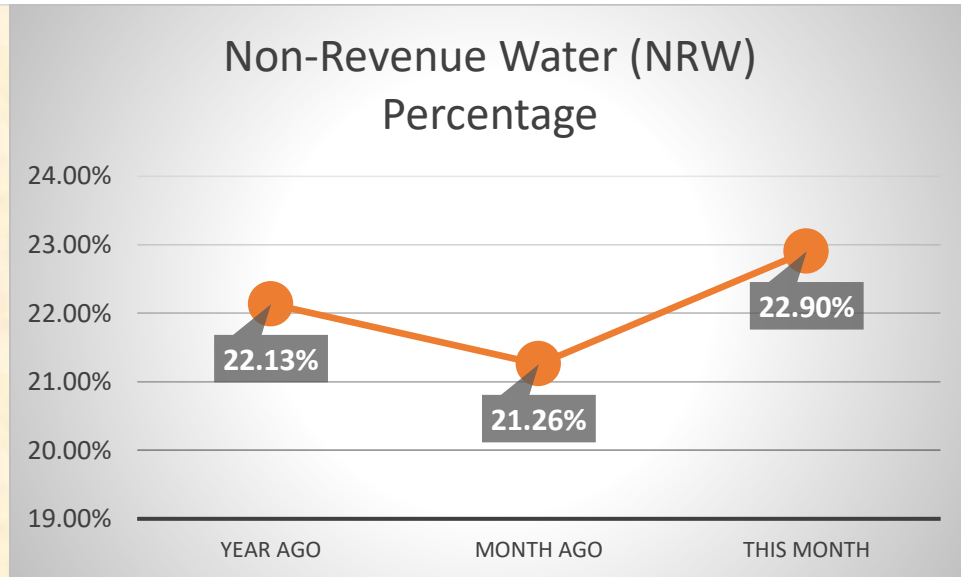


Digos Water District


Water Statistics (January 2020)

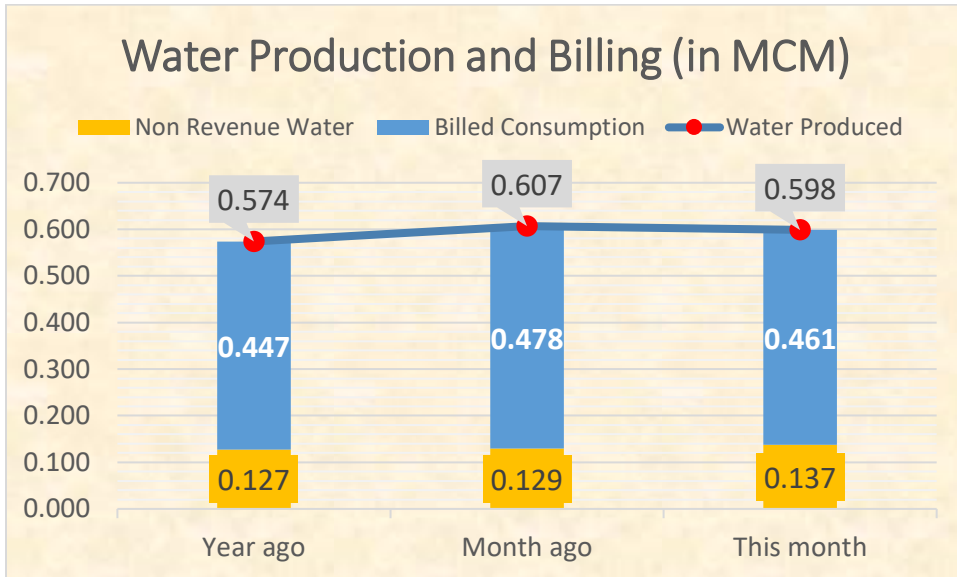

Digos Water District

Water Statistics (January 2020)

POWER CONSUMPTION (IN MILLION KWH)

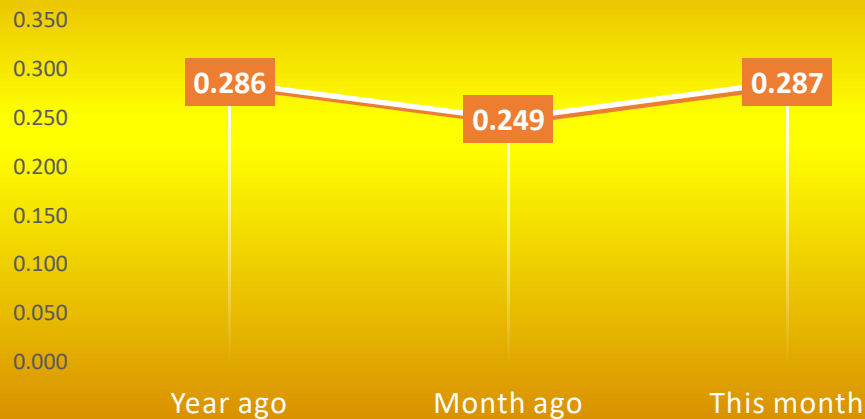


Water Quality

Microbiological Test

Population actually served by utility	113,340
Required minimum number of sample	24
No. of samples examined	30
<ul style="list-style-type: none"> Samples showing presence of coliform group Samples showing presence of coliform colonies Samples showing presence of coliform Heterotrophic Plate Count (HPC) <ul style="list-style-type: none"> % of samples that meets standard 	0 n/a n/a 100%
Average Chlorine Residual	0.47 ppm

No. of Active Service Connections per Employee

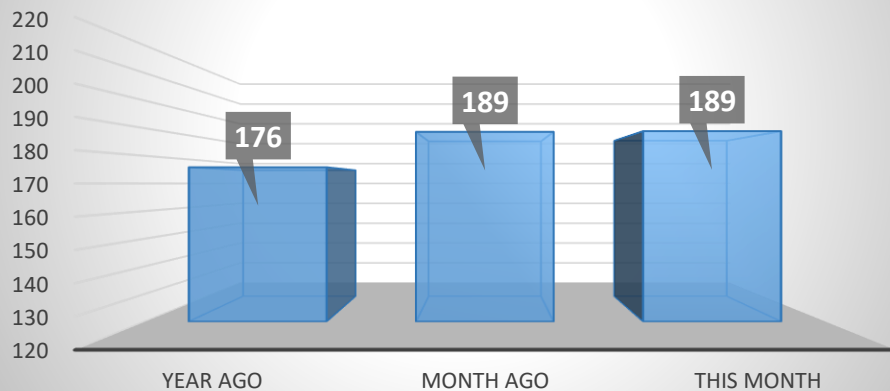

EMPLOYEE PROFILE

