
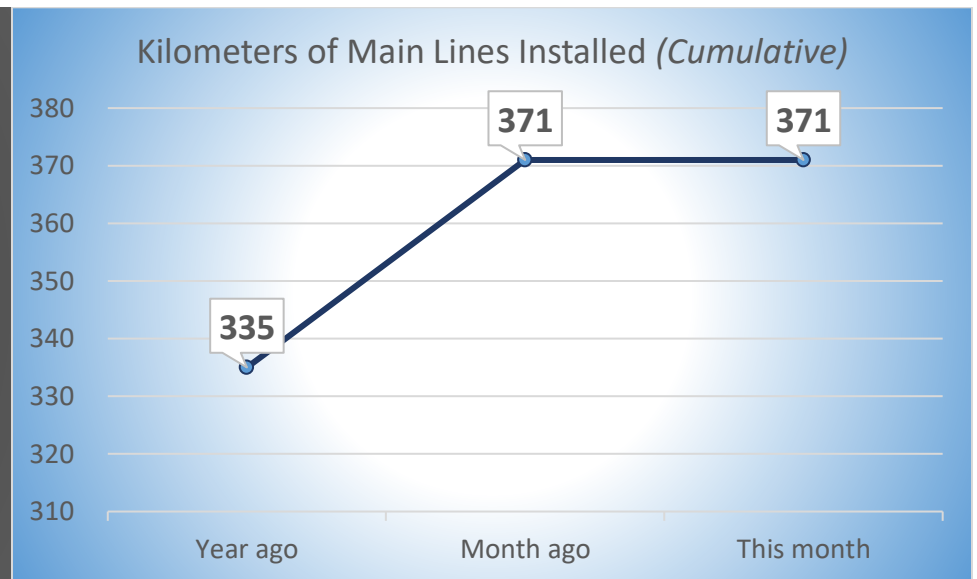
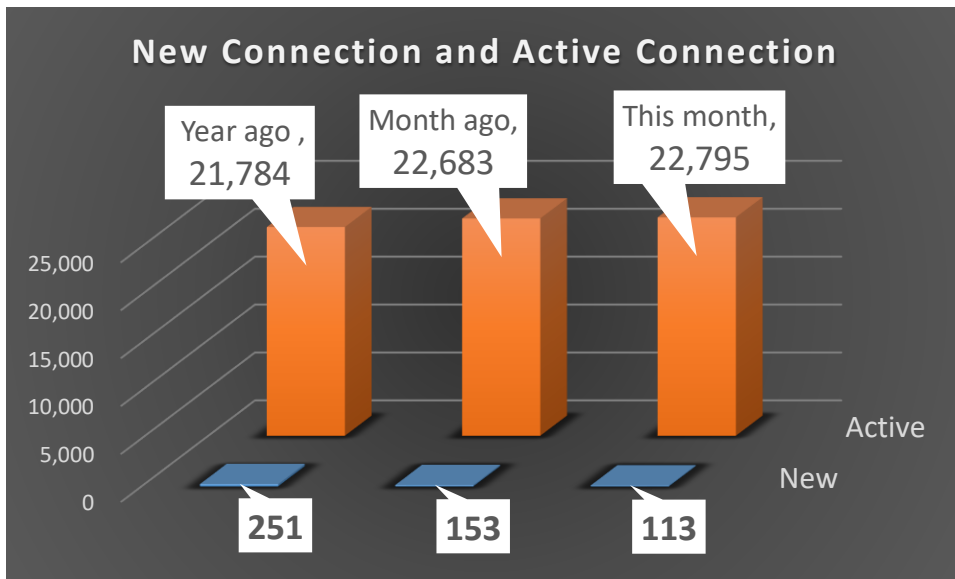
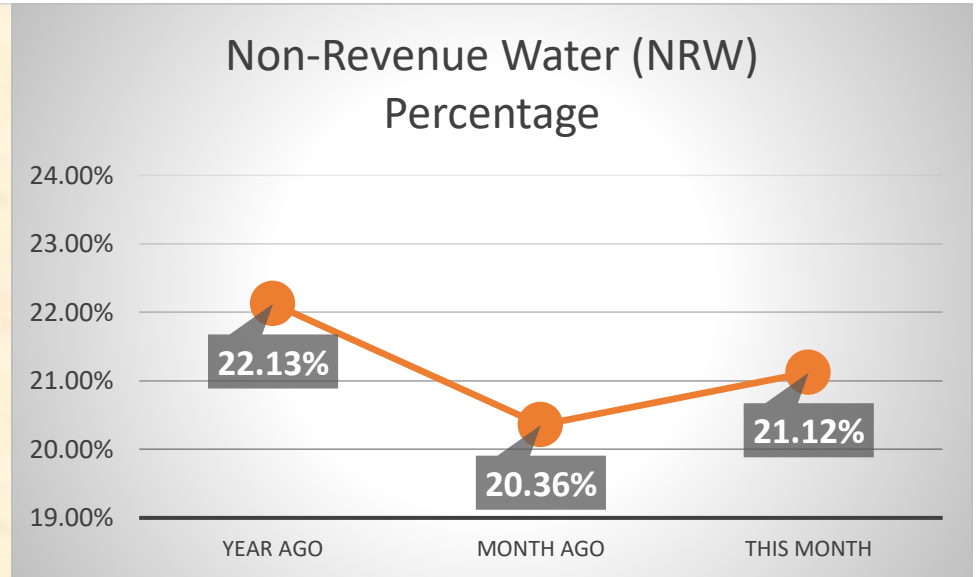


# Digos Water District


## Water Statistics (March 2020)

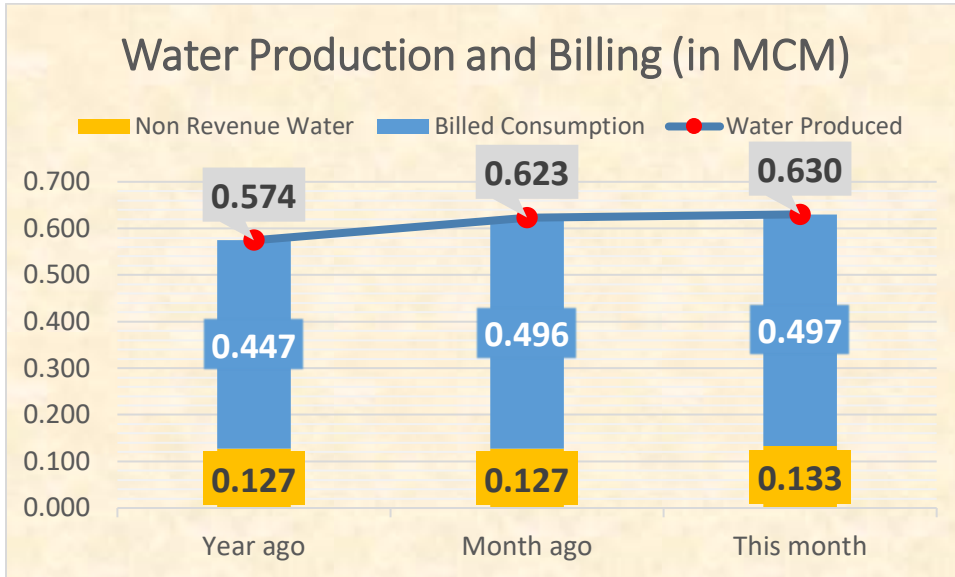

# Digos Water District

## Water Statistics (March 2020)

### POWER CONSUMPTION (IN MILLION KWH)

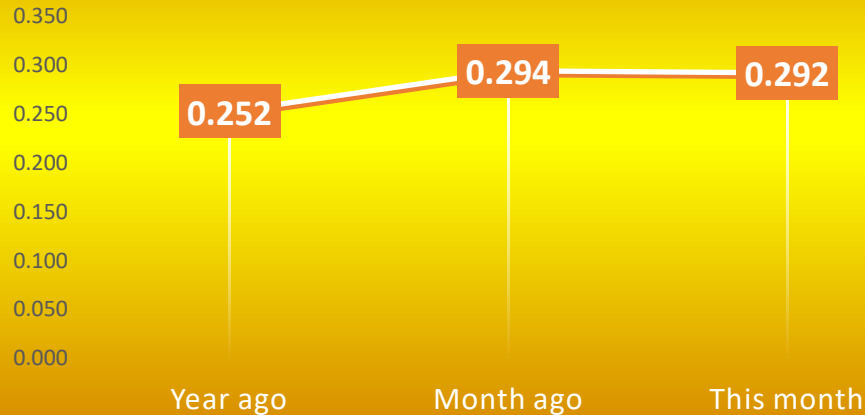


### Water Quality

#### Microbiological Test

Population actually served by utility	113,975
Required minimum number of sample	24
No. of samples examined	30
o Total Coliform	Met Standards
o Thermotolerant Coliform / E. coli	Met Standards
o Heterotrophic Place Count (HPC)	Met Standards
Disinfection Residual	
Using Free Residual Chlorine	
Standards Range = 0.3 ppm - 1.5 ppm	
o No. of days without a test conducted	0
o Average Chlorine Residual	0.47 ppm

### No. of Active Service Connections per Employee

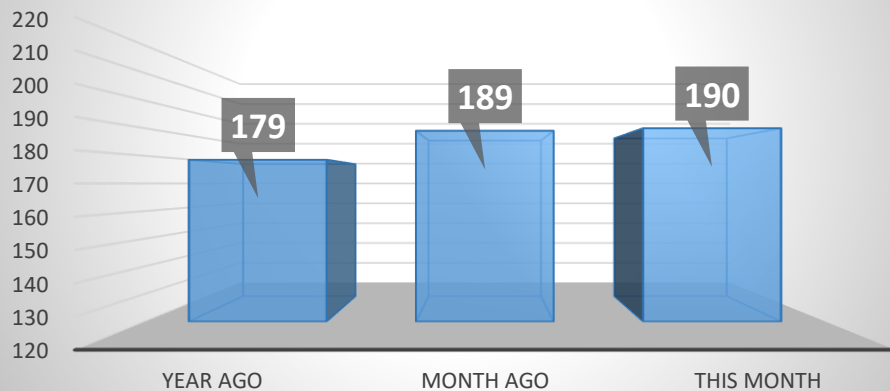

### EMPLOYEE PROFILE

