
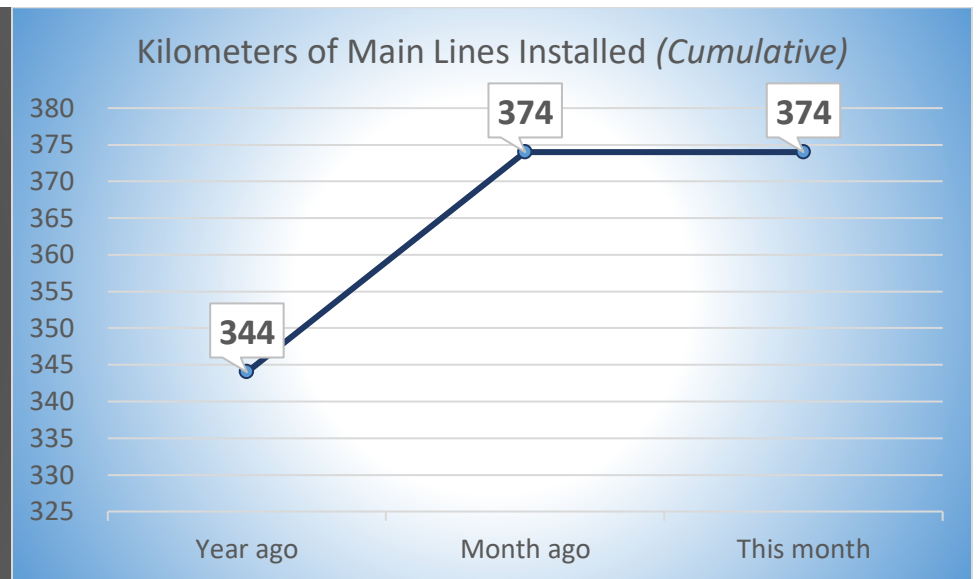
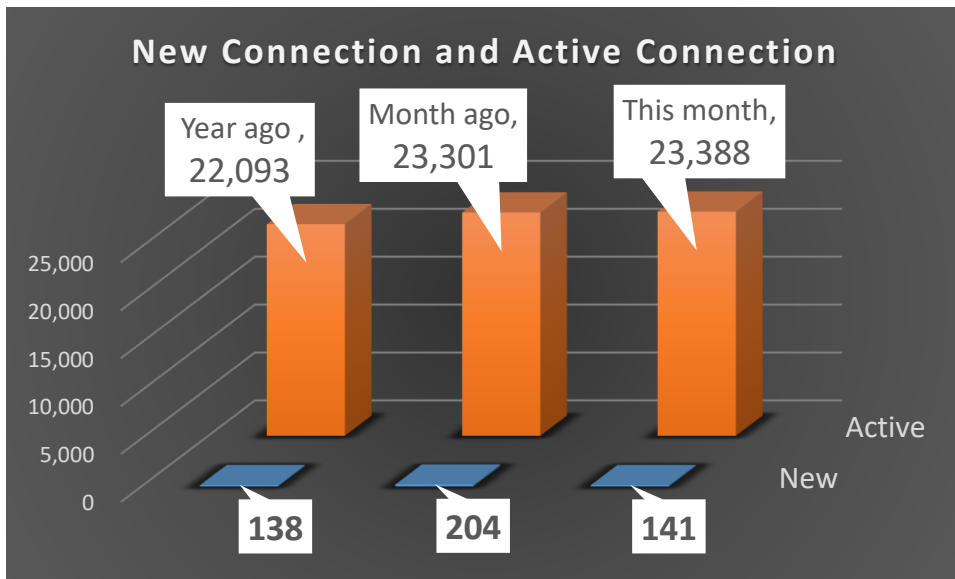
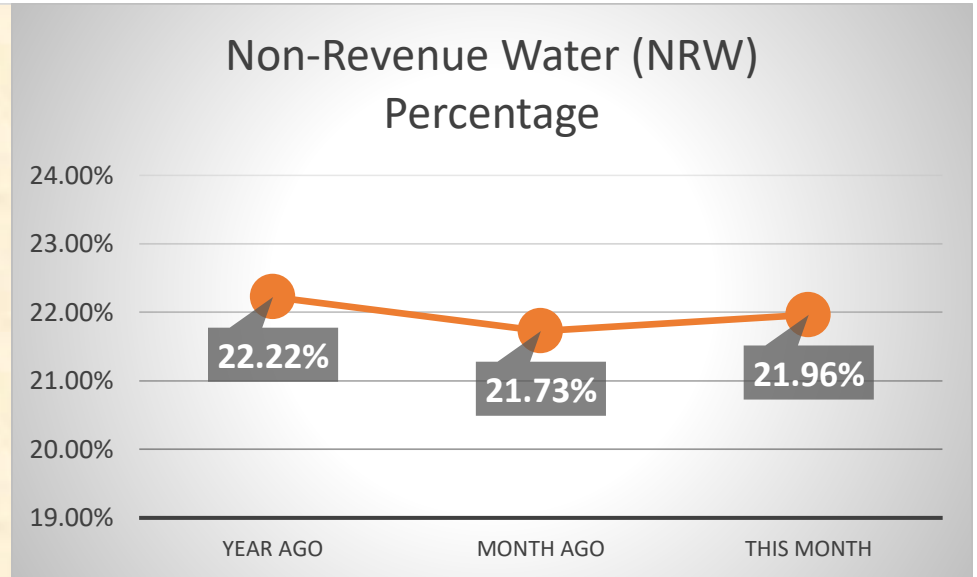


Digos Water District


Water Statistics (July 2020)

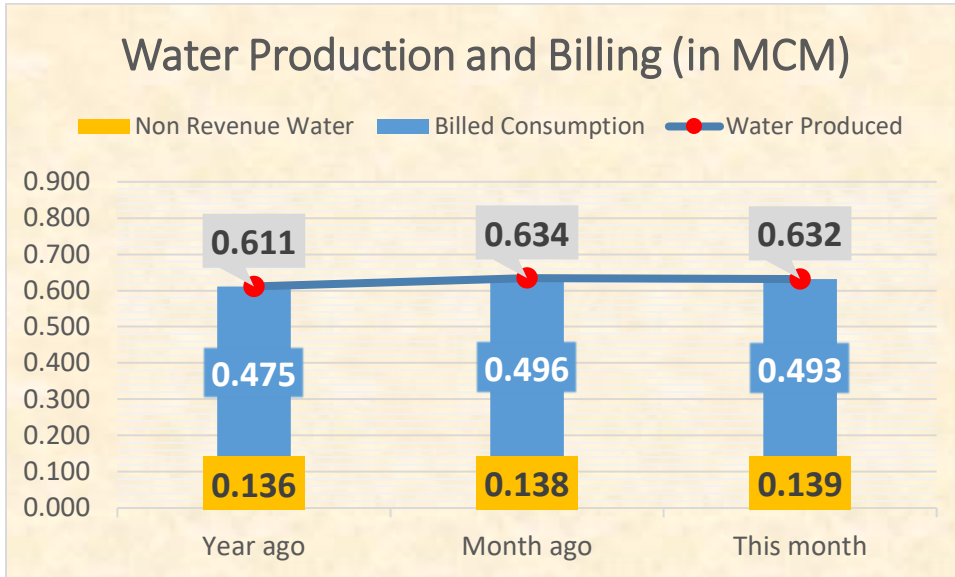

Digos Water District

Water Statistics (July 2020)


POWER CONSUMPTION (IN MILLION KWH)

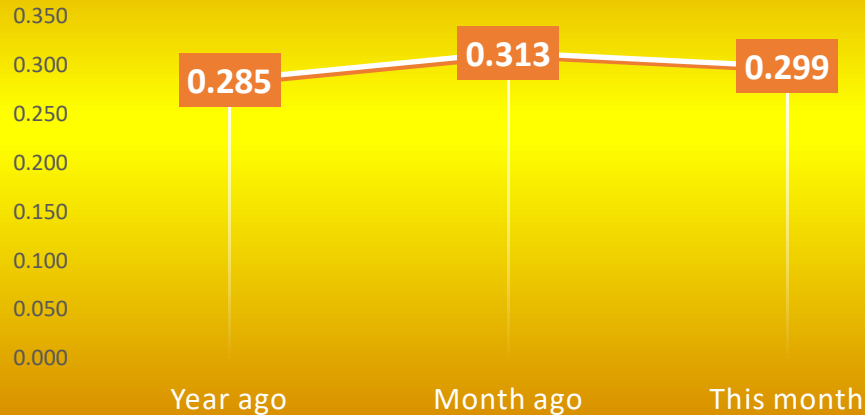

Water Quality Microbiological Test

Population actually served by utility	116,940
Required minimum number of samples	24
No. of samples examined	24
<ul style="list-style-type: none"> ○ Total Coliform ○ Thermotolerant Coliform / E. coli ○ Heterotrophic Place Count (HPC) 	Met Standards
Disinfection Residual <i>Using Free Residual Chlorine</i> Standards Range = 0.3 ppm - 1.5 ppm	
<ul style="list-style-type: none"> ○ No. of days without a test conducted ○ Average Chlorine Residual 	0 out of 31 days 0.48 ppm

No. of Active Service Connections per Employee

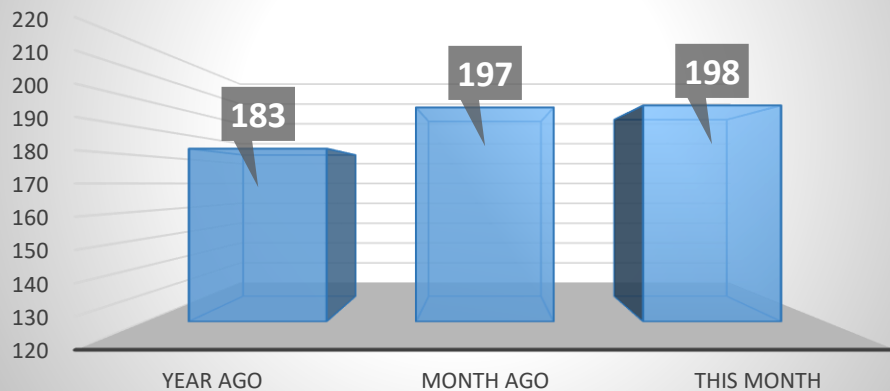

EMPLOYEE PROFILE

