
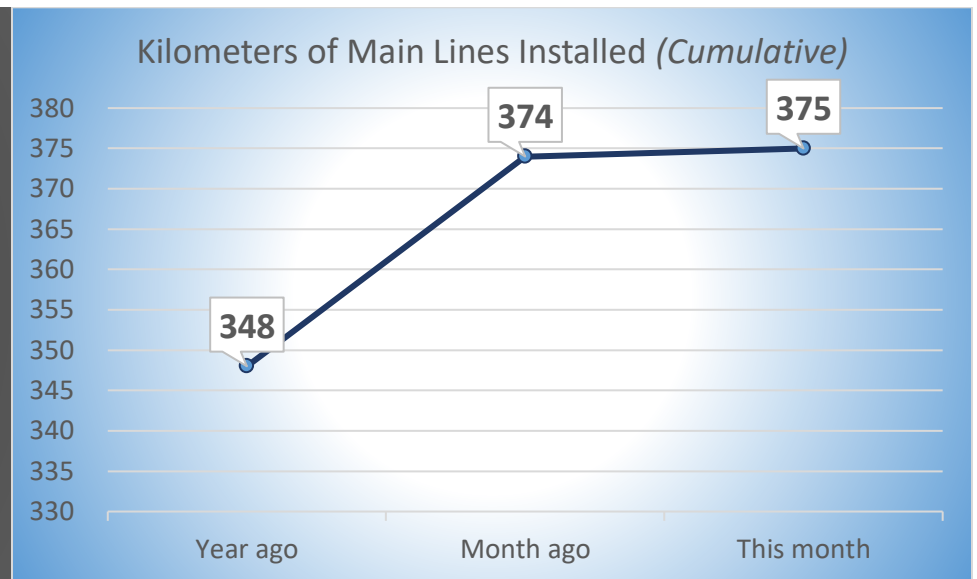
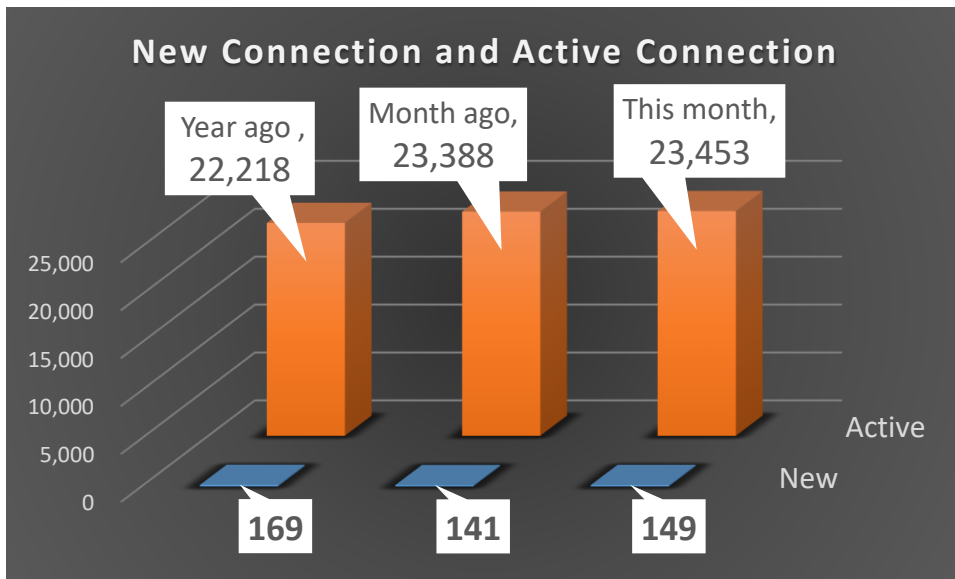
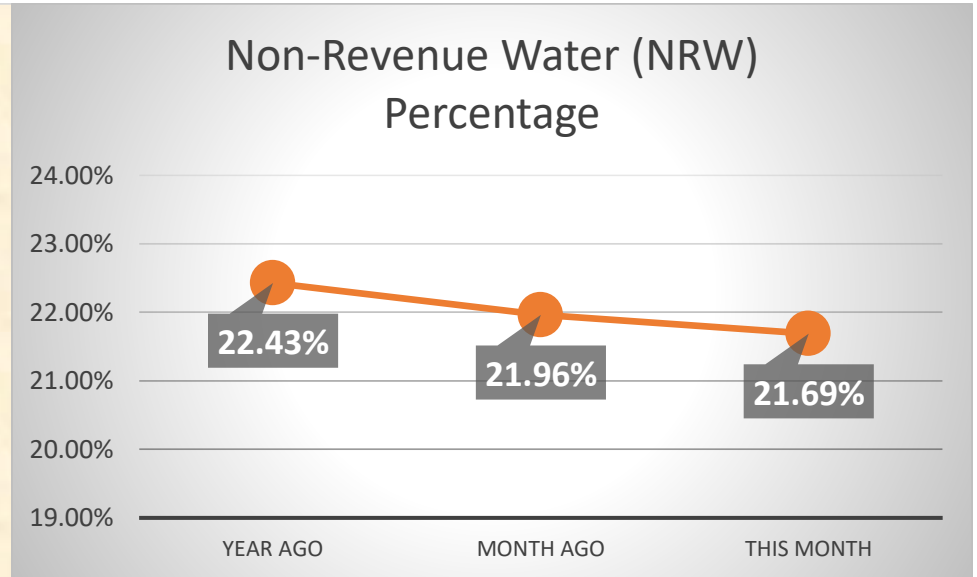



Digos Water District

Water Statistics (August 2020)

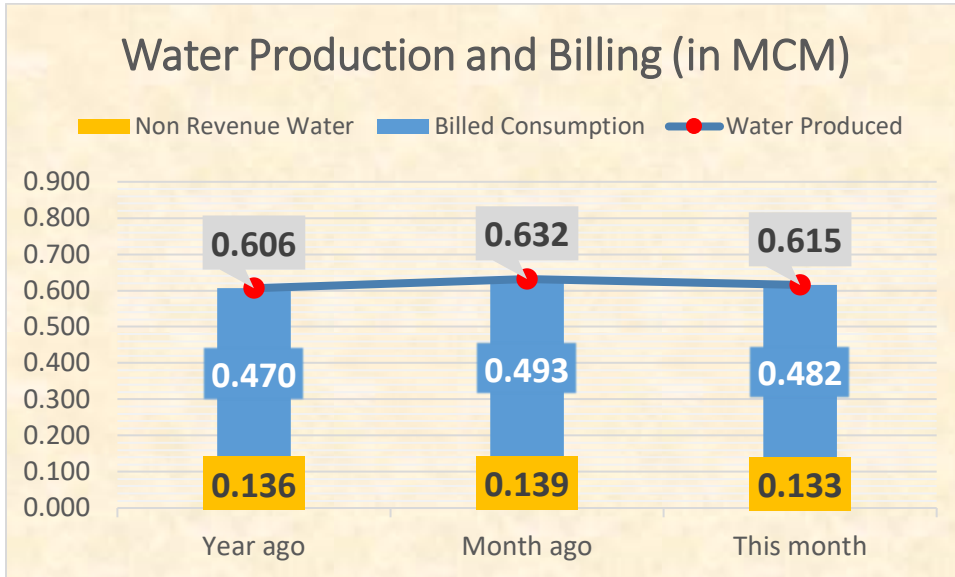

Digos Water District


Water Statistics (August 2020)

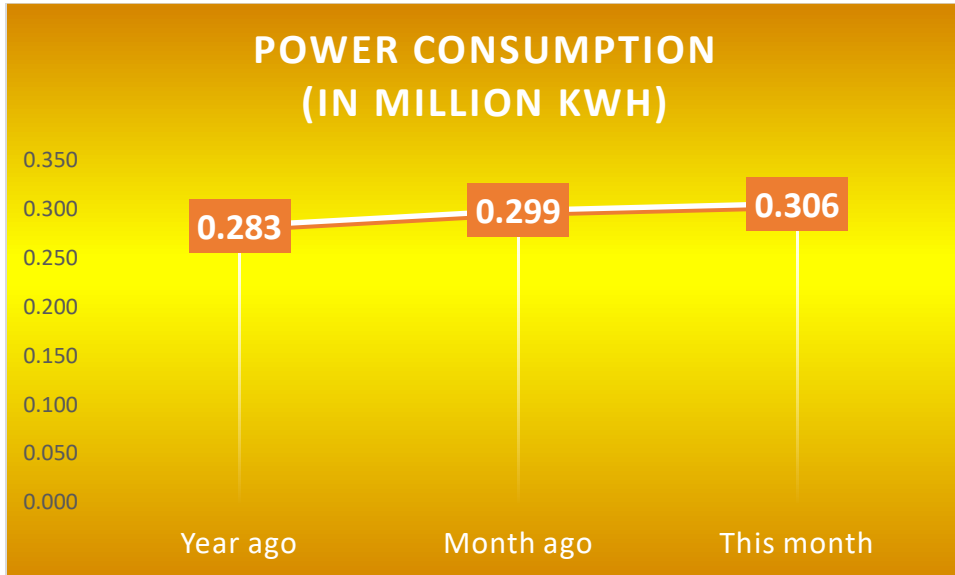

Water Quality

Microbiological Test

Population actually served by utility	117,265
Required minimum number of samples	24
No. of samples examined	24
o Total Coliform	Met Standards
o Thermotolerant Coliform / E. coli	Met Standards
o Heterotrophic Place Count (HPC)	Met Standards
Disinfection Residual <i>Using Free Residual Chlorine</i> Standards Range = 0.3 ppm - 1.5 ppm	
o No. of days without a test conducted	0 out of 31 days
o Average Chlorine Residual	0.48 ppm

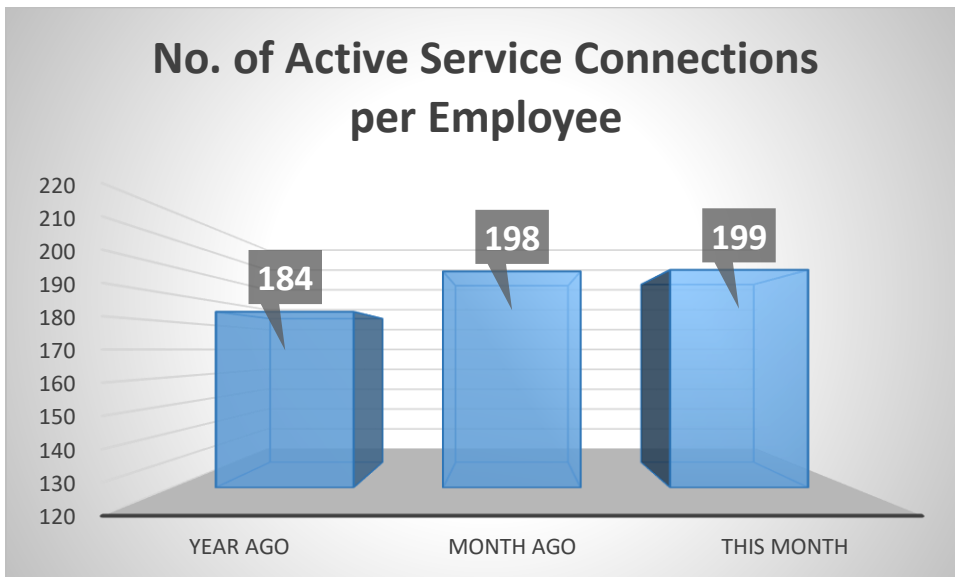

EMPLOYEE PROFILE

