
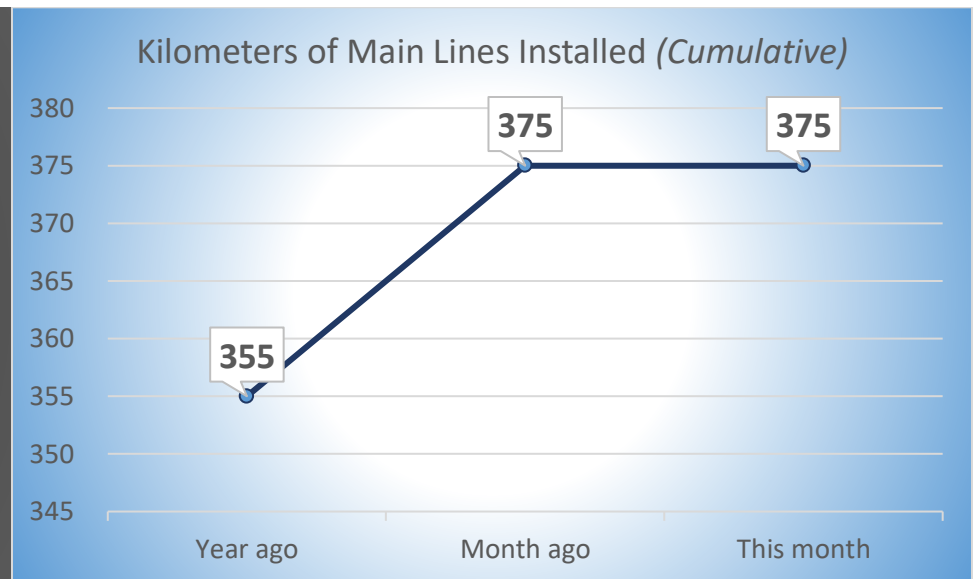
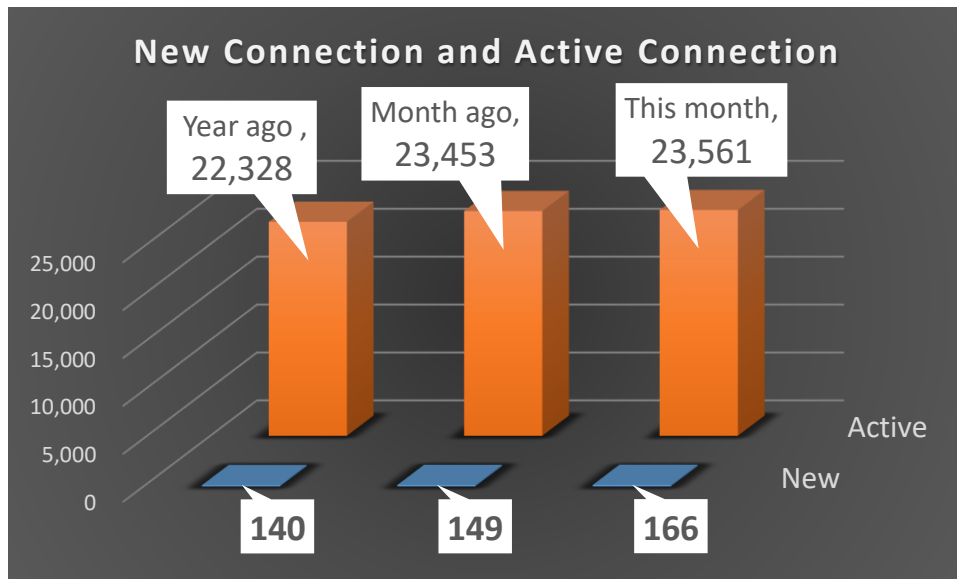
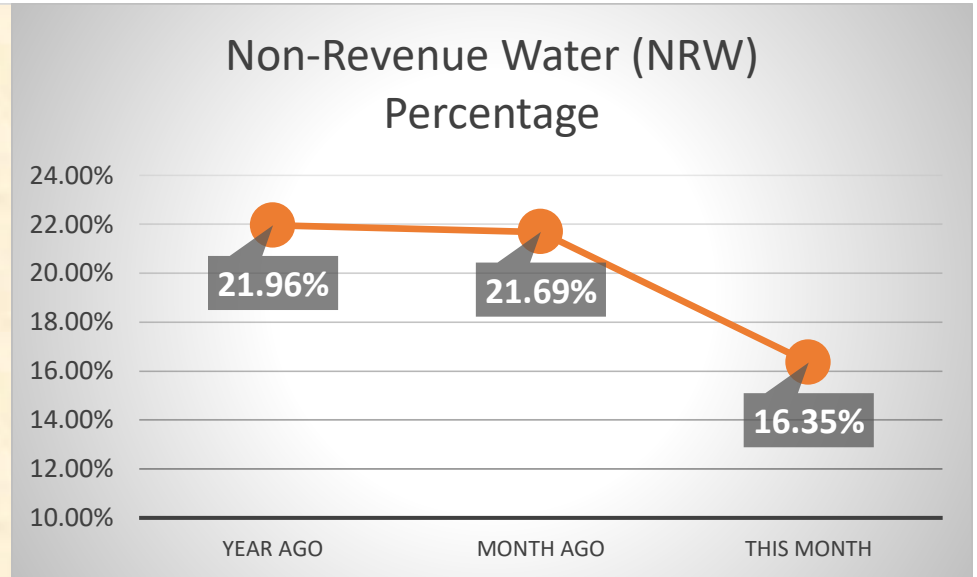



Digos Water District

Water Statistics (September 2020)

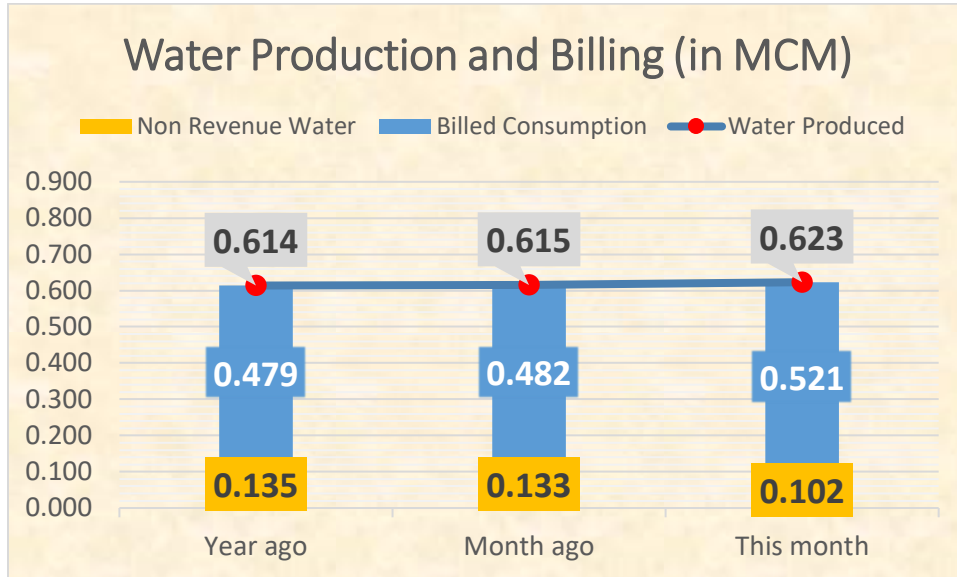

Digos Water District

Water Statistics (September 2020)

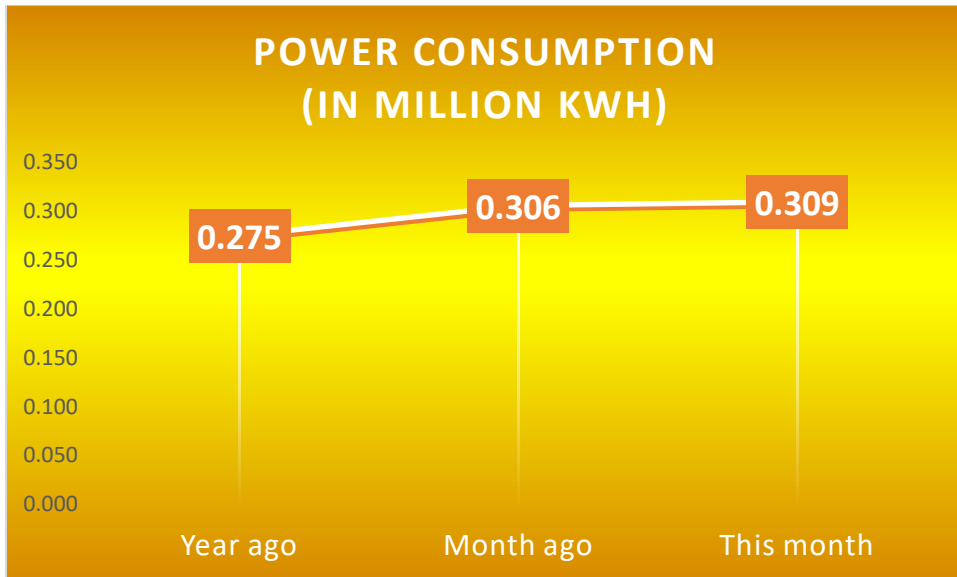

Water Quality Microbiological Test

Population actually served by utility	117,805
Required minimum number of samples	24
No. of samples examined	24
<ul style="list-style-type: none"> Total Coliform 	Met Standards
<ul style="list-style-type: none"> Thermotolerant Coliform / E. coli 	Met Standards
<ul style="list-style-type: none"> Heterotrophic Place Count (HPC) 	Met Standards
Disinfection Residual <i>Using Free Residual Chlorine</i> Standards Range = 0.3 ppm - 1.5 ppm	
<ul style="list-style-type: none"> No. of days without a test conducted 	0 out of 30 days
<ul style="list-style-type: none"> Average Chlorine Residual 	0.48 ppm

