
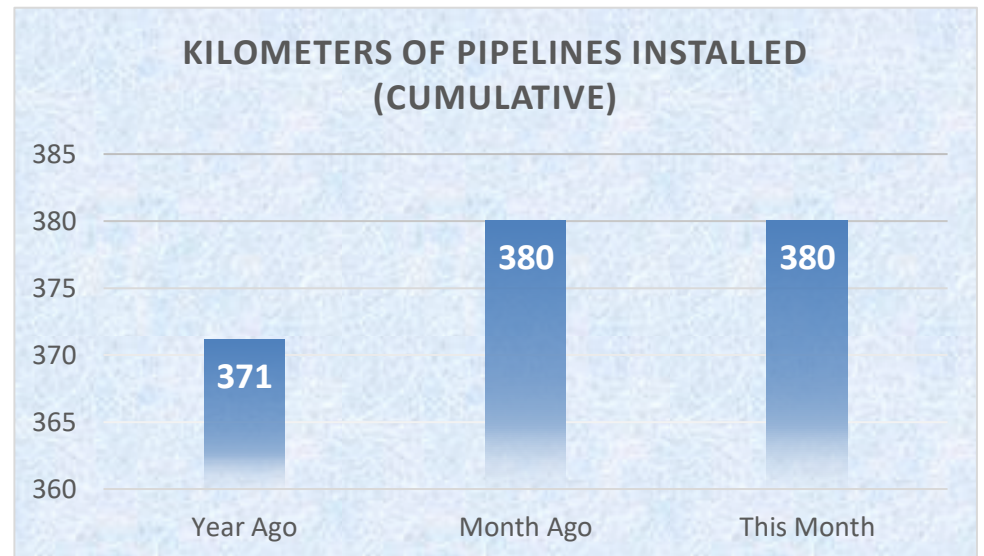
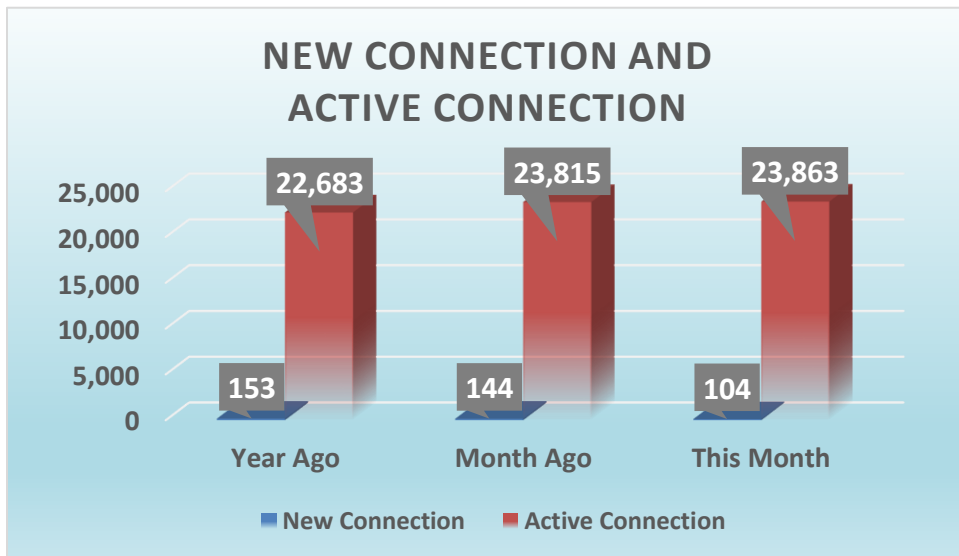
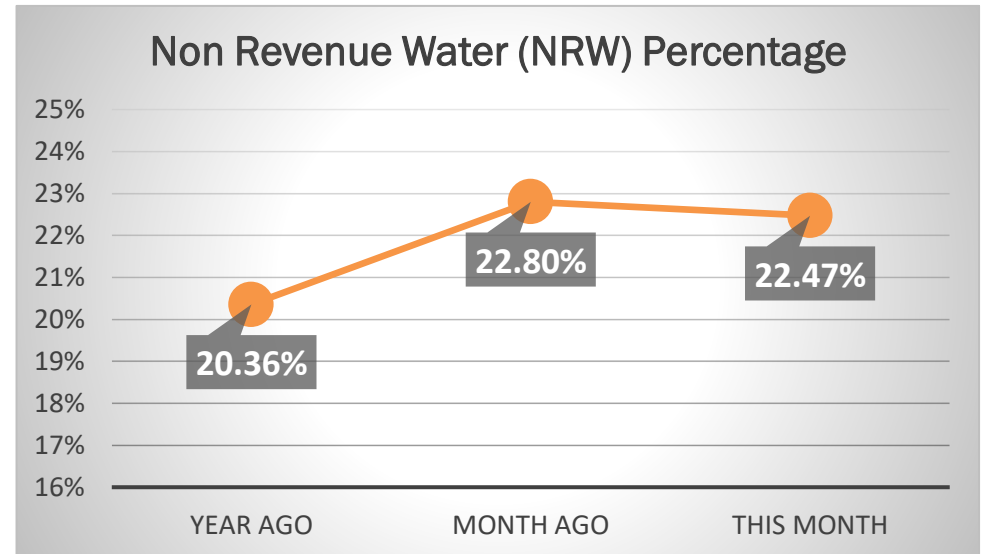



Digos Water District

Water Statistics (February 2021)

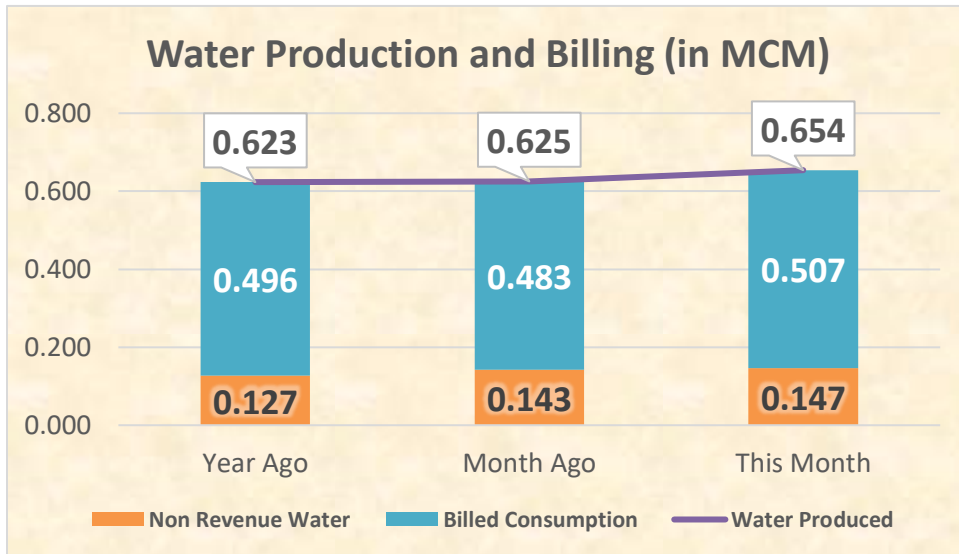

Digos Water District

Water Statistics (February 2021)

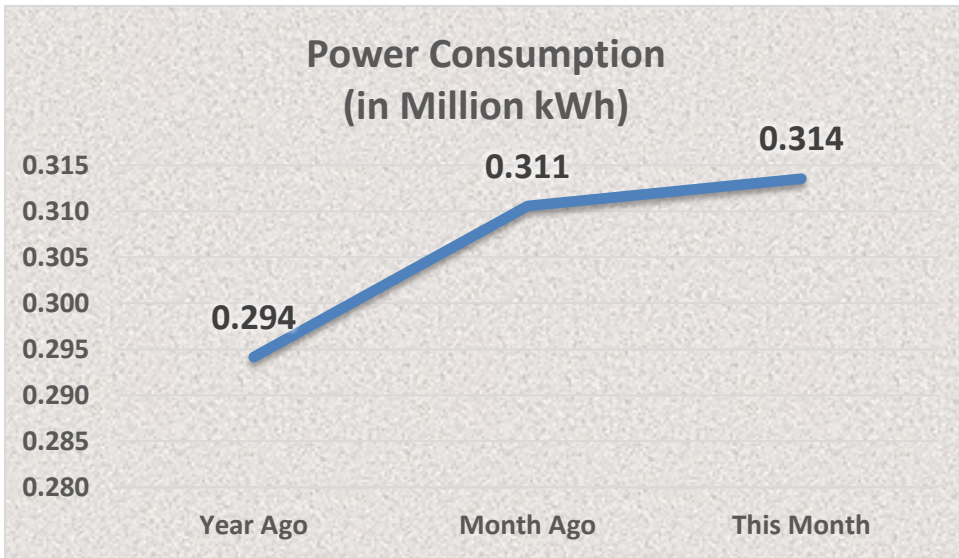

Microbiological Test

Population actually served by utility	119,315
Required minimum number of samples	24
No. of samples examined	24
● Total Coliform	Met Standards
● Thermotolerant Coliform / E. coli	Met Standards
● Heterotrophic Place Count (HPC)	Met Standards
Disinfection Residual (Standards Range = 0.3ppm - 1.5ppm)	
● No. of days without a test conducted	0 out of 28 days
● Average Chlorine Residual	0.49 ppm

