
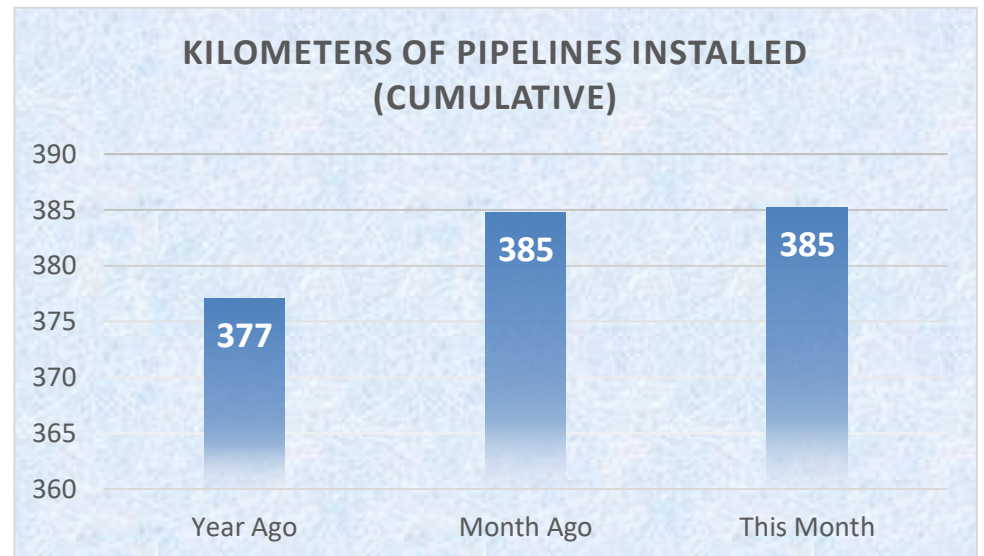
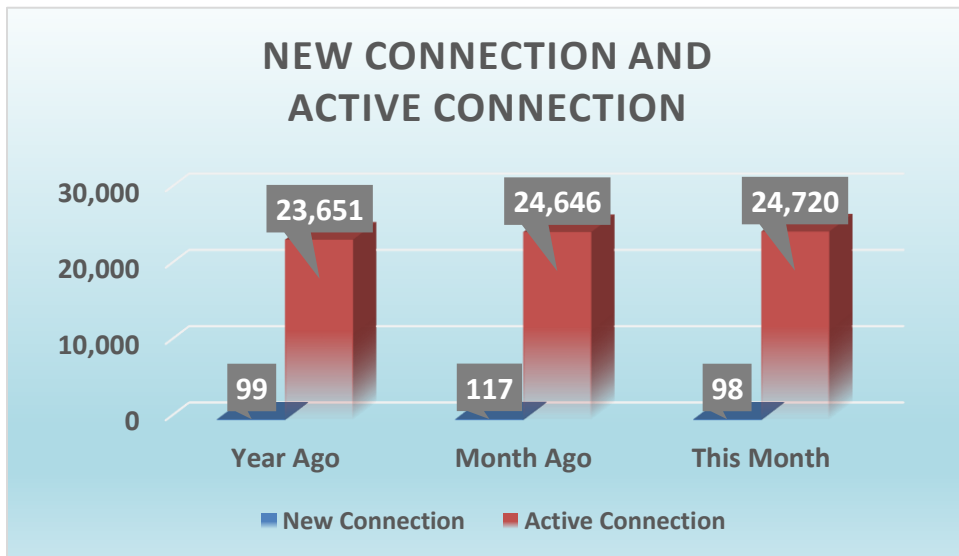
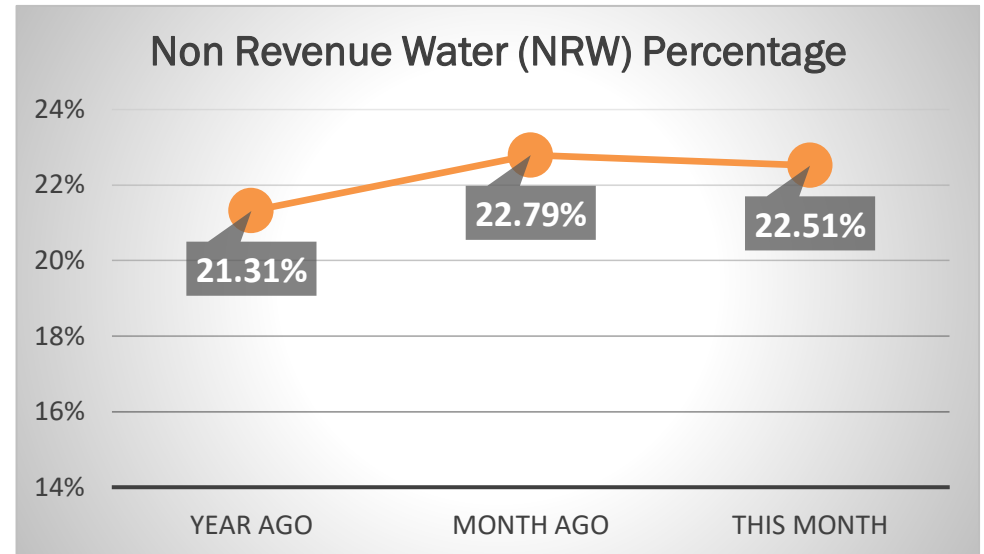



# Digos Water District

## Water Statistics (November 2021)

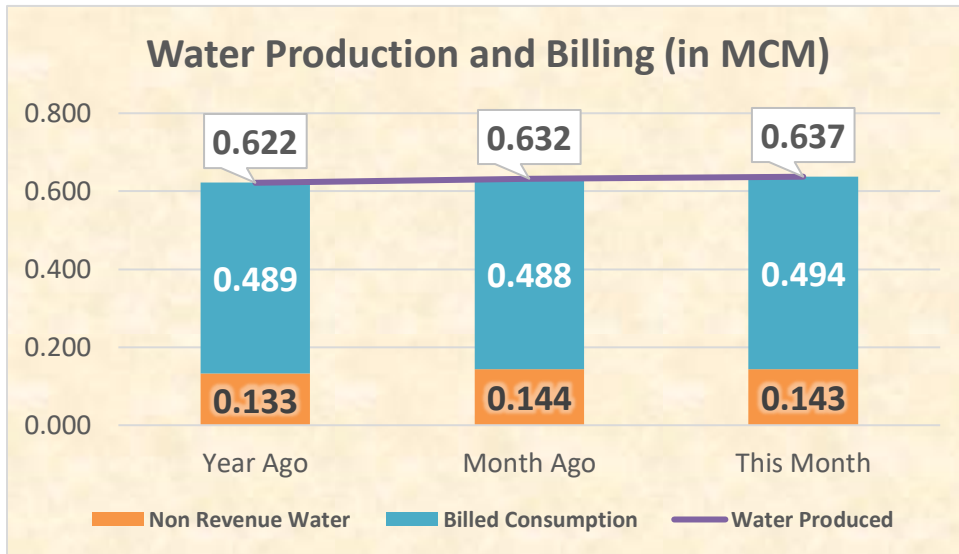

# Digos Water District

## Water Statistics (November 2021)

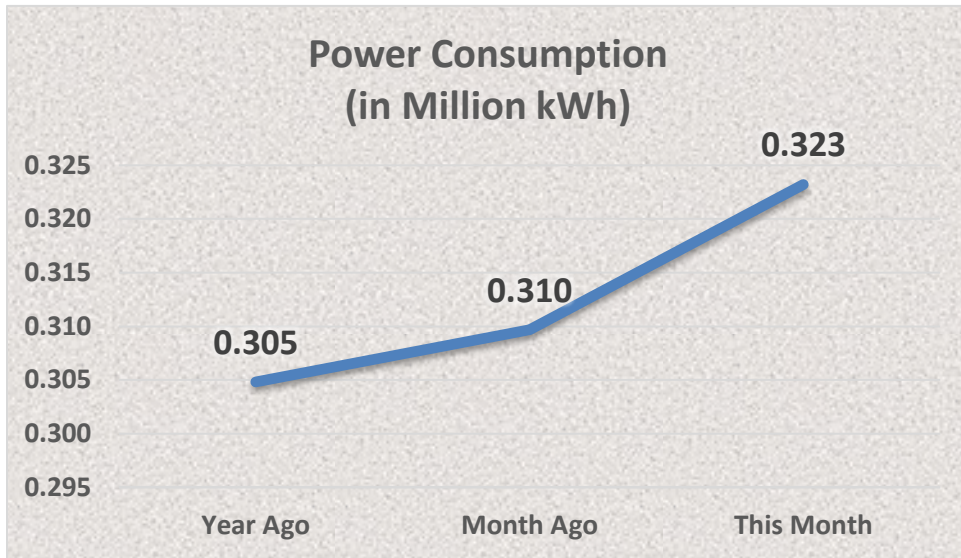

### Microbiological Test

Population actually served by utility	123,600
Required minimum number of samples	25
No. of samples examined	25
● Total Coliform	<b>Met Standards</b>
● Thermotolerant Coliform / E. coli	<b>Met Standards</b>
● Heterotrophic Place Count (HPC)	<b>Met Standards</b>
Disinfection Residual (Standards Range = 0.3ppm - 1.5ppm)	
● No. of days without a test conducted	<b>0 out of 30 days</b>
● Average Chlorine Residual	<b>0.48 ppm</b>

