
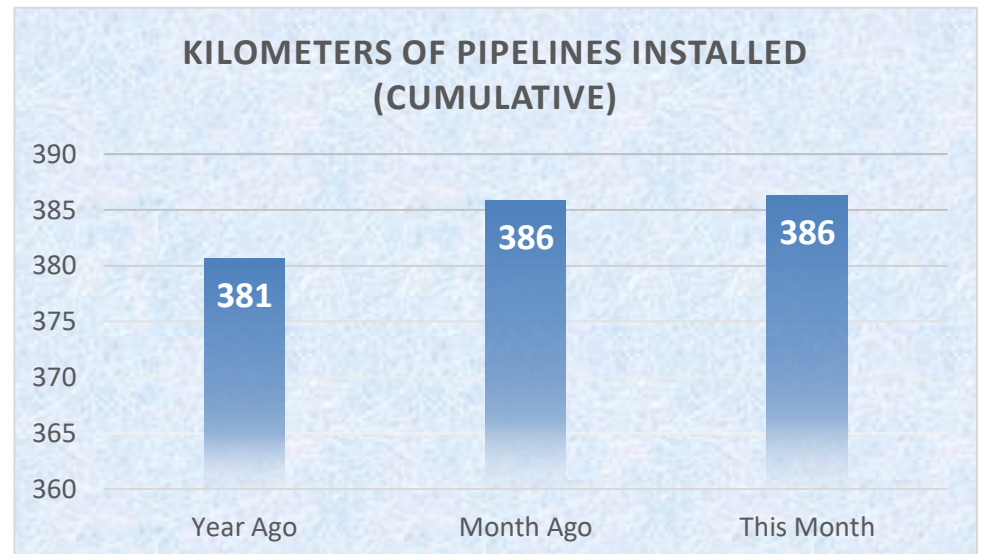
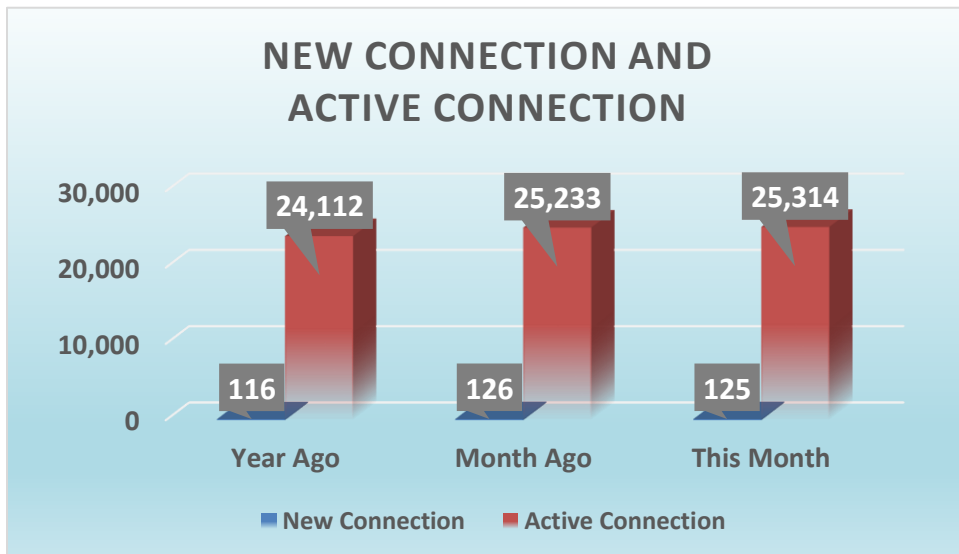
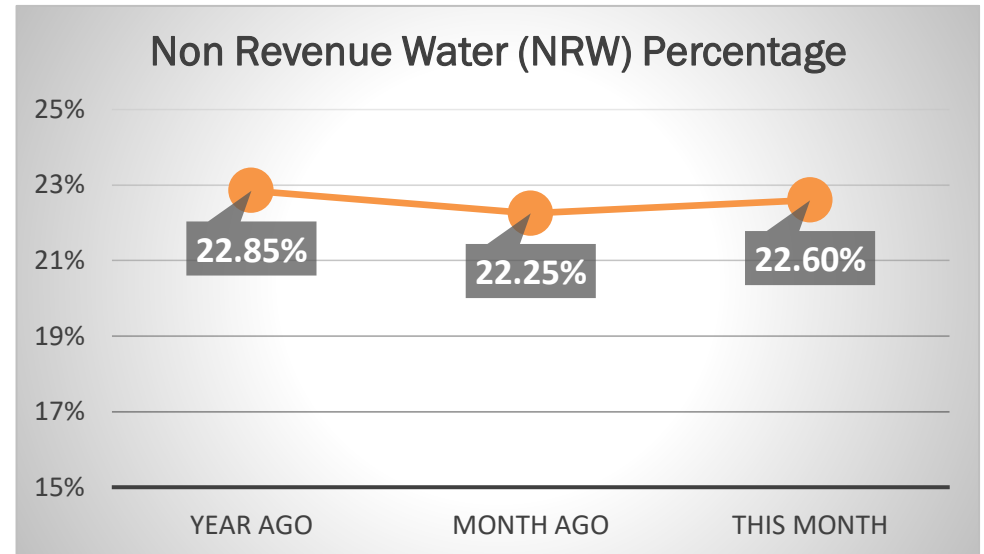



# Digos Water District

## Water Statistics (April 2022)

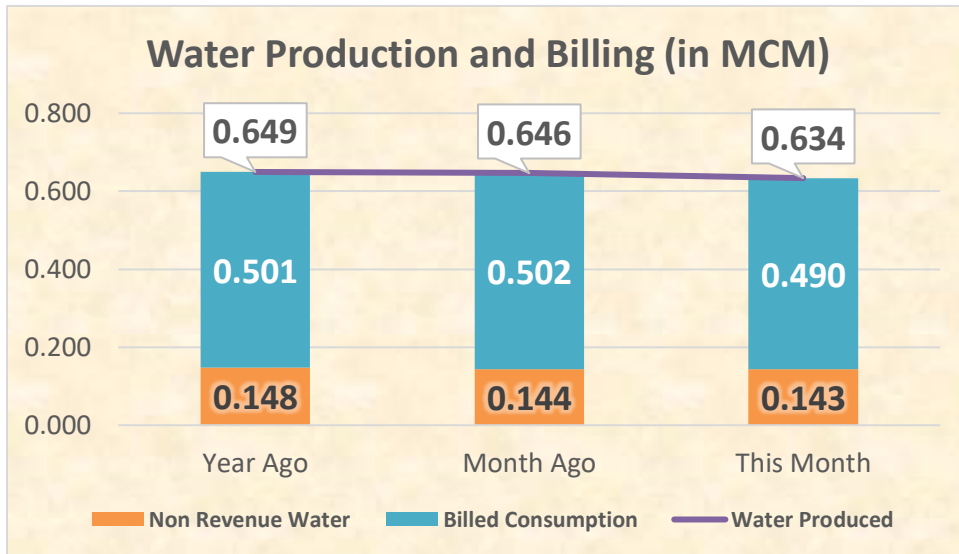

# Digos Water District

## Water Statistics (April 2022)

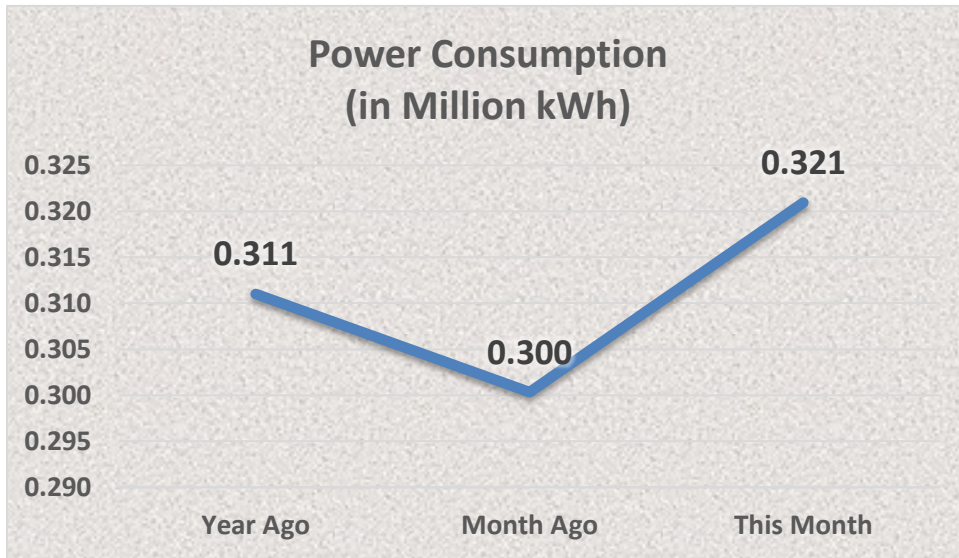

### Microbiological Test

|   |                  |
|---|------------------|
| Population actually served by utility                     | 126,570          |
| Required minimum number of samples                        | 25               |
| No. of samples examined                                   | 25               |
| ● Total Coliform  | Met Standards    |
| ● Thermotolerant Coliform / E. coli                       | Met Standards    |
| ● Heterotrophic Place Count (HPC)                         | Met Standards    |
| Disinfection Residual (Standards Range = 0.3ppm - 1.5ppm) |                  |
| ● No. of days without a test conducted                    | 0 out of 30 days |
| ● Average Chlorine Residual                               | 0.51 ppm         |

