
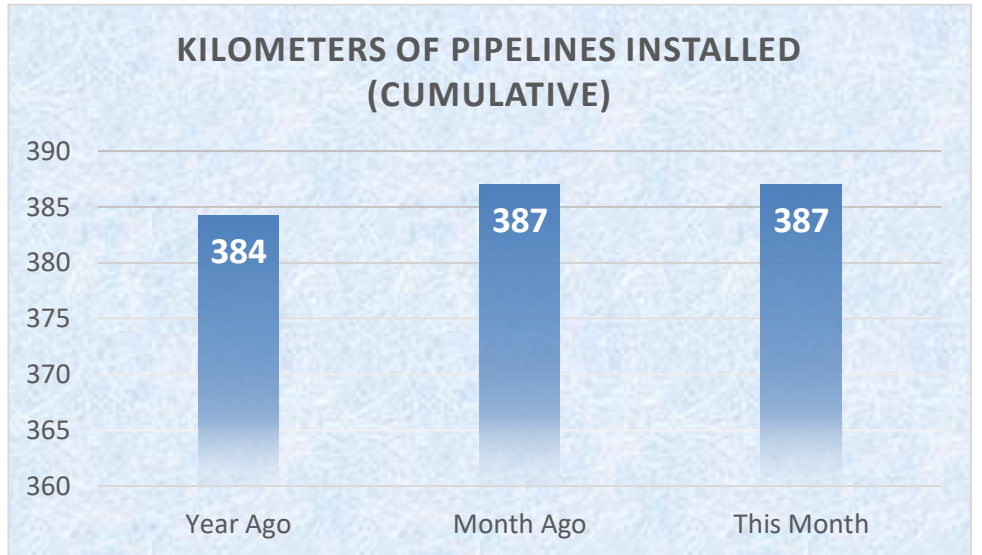
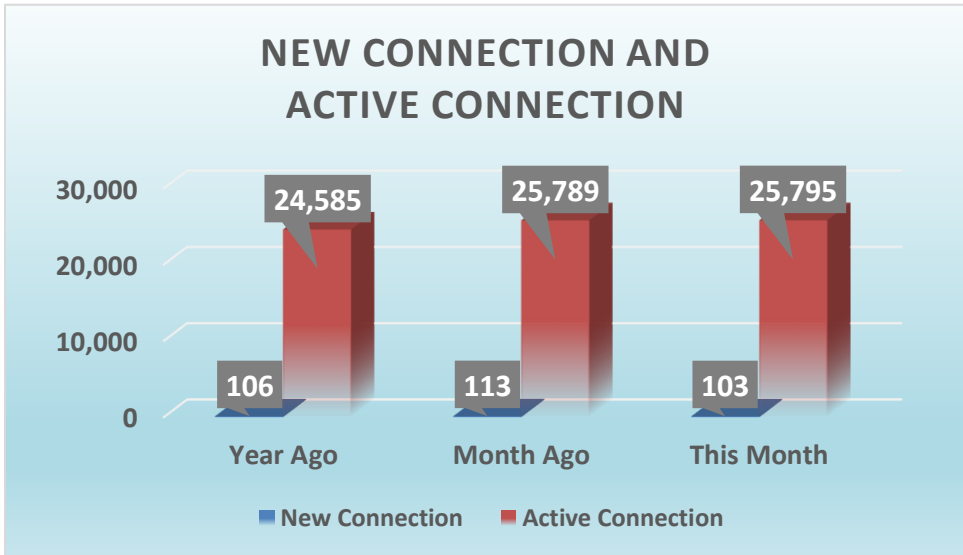
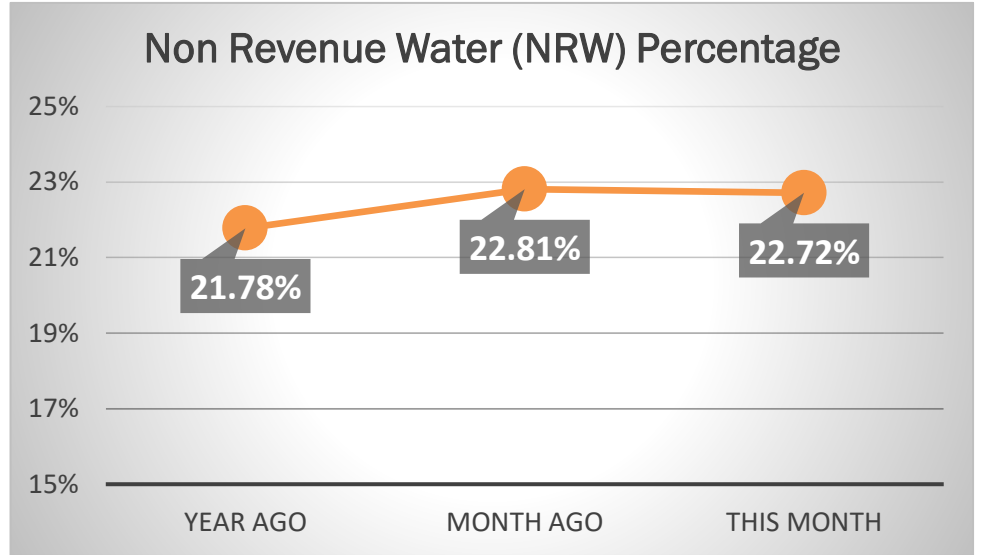



Digos Water District

Water Statistics (September 2022)

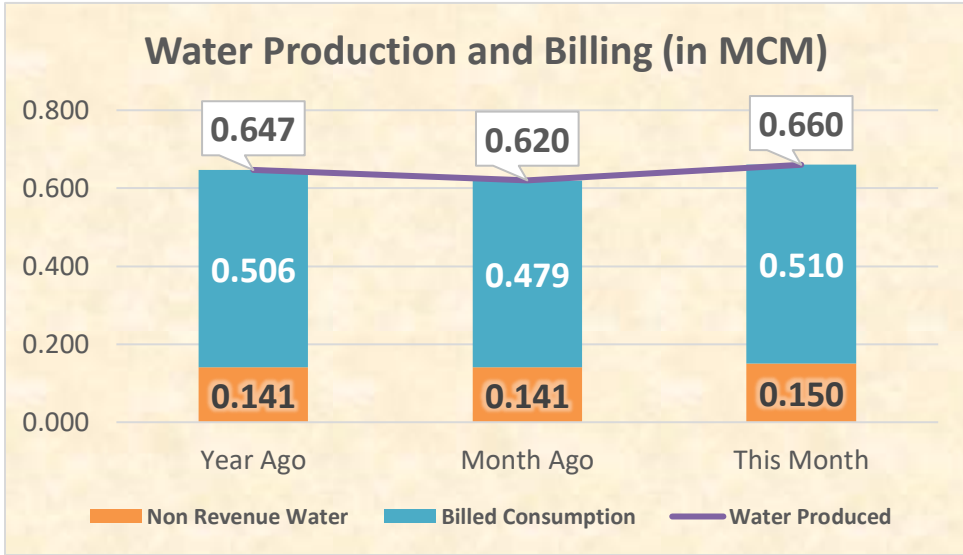

Digos Water District

Water Statistics (September 2022)

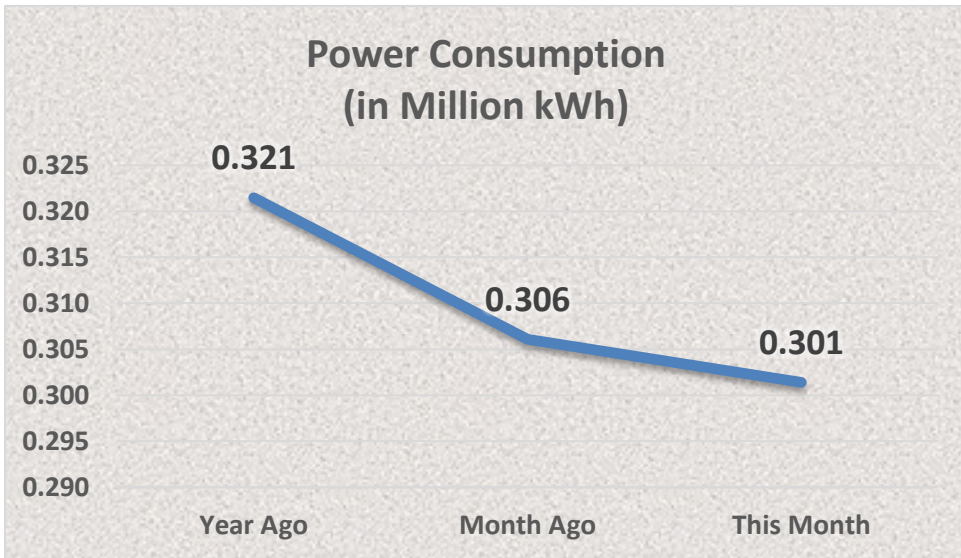

Microbiological Test

Population actually served by utility	128,975
Required minimum number of samples	25
No. of samples examined	25
● Total Coliform	Met Standards
● Thermotolerant Coliform / E. coli	Met Standards
● Heterotrophic Place Count (HPC)	Met Standards
Disinfection Residual (Standards Range = 0.3ppm - 1.5ppm)	
● No. of days without a test conducted	0 out of 30 days
● Average Chlorine Residual	0.49 ppm

